



Staff Report

Infill Housing Design Review Committee

File Number: 3-L-22-IH

Meeting: 3/16/2022
Applicant: Amber Culpepper Lafayette Investments LLC
Owner: Amber Culpepper Lafayette Investments LLC

Property Information

Location: 3425 Gap Rd. **Parcel ID** 81 I T 007
Zoning: RN-2 (Single-Family Residential Neighborhood)
District: Lonsdale Infill Housing Overlay District

Description of Work

Level III New Primary Structure

New primary residence fronting Gap Road. Two-story, front-gable roof residence measures 22' wide by 32' long. The façade features a lower, 6/12 pitch front-gable roof massing with interior space on the second story, cantilevered over a 3' deep entry stoop. The house is proposed to be set approximately 24' from the front property line. The parking extends off Gap Road on the right side of the house, with a 10' wide driveway which leads to a parking pad at the rear of the house.

The two-story house features a 6/12 pitch, front-gable roof clad in asphalt shingles, an exterior of fiber cement lap siding, and a CMU foundation. The 3' deep entry porch is recessed under the second-story cantilevered massing, supported by 6 by 6 square posts. The façade (northeast) features one 10' wide, 5' tall bay of three adjoining windows. The second story has a rectangular fixed window followed by three adjoining 4/1 single-hung vinyl windows on the projecting massing. The front gable fields are clad in fiber cement shakes. The left side (west) elevation features two smaller-sized windows on the first story and two on the second. On the rear elevation, a secondary entry accesses a rear deck.

Applicable Design Guidelines

Heart of Knoxville Infill Housing Design Guidelines

1. Front Yards

- Consistent front yard space should be created along the street with the setback of a new house matching the older houses on the block.
- When several infill houses, porches and the habitable portion of each house should be about the same distance from the street as the original houses.
- A walkway should be provided from the sidewalk or street to the front door. Along grid streets, the walk should be perpendicular to the street.
- Healthy trees that are outside the building footprint should be preserved. The root area should be marked and protected during construction.

2. House Orientation and Side Yards

- New housing should be proportional to the dimensions of the lot and other houses on the block.

- Side yard setbacks should be similar to older houses on the block, keeping the rhythm of spacing between houses consistent.

3. Alleys, Parking, and Services

- Parking should not be in front yards.
- Alley access should be used for garage or parking pad locations.
- On streets without alleys, garages or parking pads should be at least 20' behind the front façade of the infill house with access limited to one lane between the street and the front façade.
- On those streets which have alleys, driveways should not be permitted from the front of the house.
- Alley oriented parking pads, garbage collection points, and utility boxes should be screened with a combination of landscaping and fencing.

4. Scale, Mass, and Foundation Height

- The front elevation should be designed to be similar in scale to the other houses along the street.
- The front façade of new houses should be about the same width as original houses on the block.
- If extensions or bays were typically part of the neighborhood's historic house design, such elements should be incorporated into infill housing.
- New foundations should be about the same height as the original houses in the neighborhood.

5. Porches and Stoops

- Porches should be part of the housing design in those neighborhoods where porches were commonplace.
- Porches should be proportional to original porches on the block, extending about 8-12' toward the street from the habitable portion of the house.
- Porches should extend into the front yard setback, if necessary, to maintain consistency with similarly sited porches along the street.
- Porch posts and railings should be like those used in the historic era of the neighborhood's development.

6. Windows and Doors

- When constructing new houses, the windows and door styles should be similar to the original or historic houses on the block.
- To respect the privacy of adjacent properties, consider the placement of side windows and doors.
- The windows and doors on the front façade of an infill house should be located in similar proportion and position as the original houses on the block.
- Attention should be paid to window placement and the ratio of solid (the wall) to void (the window and door openings).
- Contemporary windows such as "picture windows" should not be used in pre-World War II neighborhoods.

7. Roof Shapes and Materials

- New roofs should be designed to have a similar pitch to original housing on the block.
- More complex roofs, such as hipped roofs and dormers, should be part of new housing designs when such forms were historically used on the block.
- Darker shades of shingle were often used and should be chosen in roofing houses in Infill neighborhoods.

8. Siding Materials

- Clapboard-like materials should be used in constructing new housing where painted wood siding was traditionally used.
- Brick, wood shingle, and other less common material may be appropriate in some older neighborhoods, particularly those with a mix of architectural styles.
- Faced stone, vertical siding, and other non-historic materials should not be used in building new houses.

11. Landscape and Other Considerations

- One native or naturalized shade tree should be planted in the front and rear yards of infill lots with 25 feet or more in depth to front of house.
-

Comments

1. The proposed front setback is 24' from the front property line. There are only three other houses on the block. 3401 Gap Road is located 42' from the front property line, and the new construction houses at 3405 and 3409 Gap Road are also set 42' from the front property line. The subject property is one of seven new houses to be constructed on the block, so the front setbacks will effectively create a new street pattern. The submitted site plans do not specifically call out the front setback measurement. Overall, the proposed front setbacks should be confirmed to create consistent front yard spaces along the block.

The seven adjacent new houses will demonstrate consistent side yard setbacks while accommodating the necessary side driveways. The applicant should confirm the left side exterior walls of all 7 houses will stay within the 5' side setback required allow windows on side elevation walls.

2. The subject block lacks historic context, which is reflected in recent Infill Housing reviews for 3405 and 3409 Gap Road (3-B-19-IH and 8-B-19-IH). Older houses nearby are transitional Ranch houses and modified Craftsmans. Existing side setbacks and lot sizes are relatively inconsistent. While two-story houses would often be disproportionately tall and large in massing on an established block in Lonsdale, the existing block is primarily vacant and two new two-story houses are located at 3405 and 3409 Gap Road.

3. There is no operable alley on the block. The proposed parking meets Infill Housing design guidelines by limiting access to one lane between the street and the façade, and the design benefits from the parking pads being placed behind the house. As proposed, the site plans meet City Engineering standards, but any modifications in permitting should meet Engineering standards and Infill Housing design guidelines.

4. The proposed front elevation is similar in scale to other houses along the street, especially the adjacent infill construction. The 22' wide, three-bay façade is comparable to historic houses' façade widths. The lower front-gable roof massing and porch roof contribute additional roofline complexity. The applicant should provide foundation heights for the proposed houses.

5. Design "B" proposes a 3' wide entry stoop underneath the cantilevered massing instead of a porch. The new house should incorporate a porch to meet design guidelines.

6. Guidelines note that "window and door styles should be similar to original or historic houses" in the surrounding context. 1/1 windows instead of the proposed 4/1 would be more appropriate for the surrounding context. The façade does not show windows in "similar proportion and position" as original houses in the neighborhood, including the three-part picture window and the single fixed window, which are disproportionate in size. The side elevations show multiple sizes of windows with somewhat irregular placement. The left side elevation would benefit from an additional bay of windows closer to the façade, as the large swath of wall with no transparency will be significantly visible from the street.

7. At 6/12, the roof has a similar pitch to original houses in the neighborhood.

8. The proposed materials meet the design guidelines.

9. Final site plans should incorporate one native or naturalized shade tree in the front and rear yards.

10. Three design variations are proposed for seven vacant lots. The proposed designs are sufficiently differentiated from each other via porch design, façade window placement, projecting front-gable roof massings, and some siding details.

Recommendation

Staff recommends approval of Certificate 3-L-22-IH, subject to the following conditions:

- 1) Front setback should be confirmed to create consistent front yard space along the block, with approval of final site plans by staff;
- 2) Left side setback to be a minimum of 5', so the left side elevations can retain windows;
- 3) Final site plan to meet City Engineering standards and Infill Housing design guidelines;
- 4) Revise design of front porch to meet design guidelines, with approval by staff;
- 5) Revise façade and side elevation windows to better meet design guidelines, with approval by staff;
- 6) Final site plan to show one tree in front and one tree in rear yard.



3-L-22-IH

APPLICATION FOR CERTIFICATE OF APPROPRIATENESS


Applicant: Amber Culppepper Lafayette Investments LLC

INFILL HOUSING REVIEW BOARD



3425 Gap Rd.
Lonsdale Infill Housing Overlay District

Original Print Date: 3/7/2022
Revised:
Knoxville/Knox County Planning - Infill Housing Design Review Committee





DESIGN REVIEW REQUEST

- DOWNTOWN DESIGN (DK)
- HISTORIC ZONING (H)
- INFILL HOUSING (IH)

Applicant

3-L-22-IH

Date Filed

Meeting Date (if applicable)

File Number(s)

CORRESPONDENCE

All correspondence related to this application should be directed to the approved contact listed below.

- Owner
- Contractor
- Engineer
- Architect/Landscape Architect

Name

Company

Address

City

State

Zip

Phone

Email

CURRENT PROPERTY INFO

Owner Name (if different from applicant)

Owner Address

Owner Phone

Property Address

Parcel ID

Neighborhood

Zoning

AUTHORIZATION

Lindsay Crockett

Lindsay Crockett

2.25.22

Staff Signature

Please Print

Date

Amber Culpepper

Applicant Signature

Please Print

Date

REQUEST

DOWNTOWN DESIGN

Level 1:

- Signs Alteration of an existing building/structure

Level 2:

- Addition to an existing building/structure

Level 3:

- Construction of new building/structure Site design, parking, plazas, landscape

See required Downtown Design attachment for more details.

Brief description of work: _____

HISTORIC ZONING

Level 1:

- Signs Routine repair of siding, windows, roof, or other features, in-kind; Installation of gutters, storm windows/doors

Level 2:

- Major repair, removal, or replacement of architectural elements or materials Additions and accessory structures

Level 3:

- Construction of a new primary building

Level 4:

- Relocation of a contributing structure Demolition of a contributing structure

See required Historic Zoning attachment for more details.

Brief description of work: _____

INFILL HOUSING

Level 1:

- Driveways, parking pads, access point, garages or similar facilities Subdivisions

Level 2:

- Additions visible from the primary street Changes to porches visible from the primary street

Level 3:

- New primary structure
 Site built Modular Multi-Sectional

See required Infill Housing attachment for more details.

Brief description of work: _____

STAFF USE ONLY

ATTACHMENTS

- Downtown Design Checklist
 Historic Zoning Design Checklist
 Infill Housing Design Checklist

ADDITIONAL REQUIREMENTS

- Property Owners / Option Holders

Level 1: \$50 • **Level 2:** \$100 • **Level 3:** \$250 • **Level 4:** \$500

FEE 1:

FEE 2:

FEE 3:

TOTAL:

GAP ROAD HOUSES - HOME OPTIONS

LAFAYETTE INVESTMENTS

3425 GAP ROAD, KNOXVILLE, TN

OWNER

Lafayette Construction & Development
 P.O. Box 32454
 Knoxville, Tennessee 37930
 CONTACT: Amber Culppepper
 EMAIL: amber@lafayette-investments.com

ARCHITECT

oysk³ architects
 1545 Western Avenue, Suite 100
 Knoxville, TN 37921
 CONTACT: Cara Knapp
 CELL PHONE: 865-523-8266
 EMAIL: Cara@oysk3architects.com




NOTE: SEE R101 ARCHITECTURAL SITE PLAN FOR HOME TYPE AND ASSOCIATED PLAT LOCATION

SHEET NUMBER	SHEET NAME	Sheet Issue Date	Current Revision Description	Current Revision Date
01 - GENERAL				
G000	COVER	02/24/22	CODE REVISIONS	02.21.22
G001	GENERAL	02/24/22	CODE REVISIONS	02.21.22
G002	GENERAL	02/24/22	CODE REVISIONS	02.21.22
05 - ARCHITECTURAL				
A100	ARCHITECTURAL SITE PLAN	02/24/22		
B-103	HOME OPTION B - FLOOR PLANS	11/19/21	CODE REVISIONS	02.21.22
B-201	HOME OPTION B - FRAMING PLANS	11/19/21	CODE REVISIONS	02.21.22
B-301	HOME OPTION B - EXTERIOR ELEVATIONS	11/19/21	CODE REVISIONS	02.21.22

FACILITY AND CODE COMPLIANCE INFO		BUILDING STANDARDS
PROPERTY ZONE	RN-2 LONSDALE NEIGHBORHOOD ASSOCIATION	SCOPE OF WORK: CUSTOM HOME DESIGNS FOR APPROX. 1,700-1,800 SQ FT. 2-STORY HOMES ON CRAWL SPACE.
PROPERTY SIZE	SEVEN (7) 40'X150' LOTS = 6,000SF EACH	ADDITIONAL CODES: ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH LOCAL CODES.
BUILDING SQUARE FOOTAGE		COVENANTS: 2018 INTL. RESIDENTIAL CODE 2018 INTL. ENERGY CONSERVATION CODE
HOME A:	MAIN FLOOR: 704SF SECOND FLOOR: 764SF TOTAL: 1468SF	ALL MATERIALS USED ARE TO BE INSTALLED WITH STRICT ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDED DETAILS & INSTRUCTIONS.
HOME B:	MAIN FLOOR: 704SF SECOND FLOOR: 764SF TOTAL: 1,468SF	FIRE RESISTANCE: EXTERIOR WALLS: 0 HR. INTERIOR WALLS: 0 HR. ROOF CONSTRUCTION: 0 HR. FLOOR CONSTRUCTION: 0 HR.
HOME C:	MAIN FLOOR: 743SF SECOND FLOOR: 743SF TOTAL: 1,486SF	DESIGN LOADS: FLOOR, 1st: 40 PSF LIVE + 10 PSF DEAD FLOOR, 2nd: 40 PSF LIVE + 10 PSF DEAD ROOF: 30 PSF LIVE + 17 PSF DEAD SLEEPING AREAS: 30 PSF LIVE + 10 PSF DEAD INTERIOR STAIRS: 40 PSF LIVE + 10 PSF DEAD EXTERIOR DECKS: 60 PSF LIVE + 10 PSF DEAD
CONSTRUCTION CLASSIFICATION	V-B, UNPROTECTED, UNSPRINKLERED	*REFER TO SNOW LOAD & WIND LOAD PER SECTION R301 OF THE INTERNATIONAL RESIDENTIAL CODE (IRC).
OCCUPANCY CLASSIFICATION	RESIDENTIAL	SEISMIC LOADING TO BE BASED ON REQUIREMENTS OF SECTION R301 OF THE IRC.
OCCUPANT LOAD	6 OCCUPANTS	
RATED WALLS	NONE	
DETECTION AND ALARM SYSTEMS	LINE VOLTAGE, INTERCONNECTED, SMOKE DETECTORS IN EACH BEDROOM AND OUTSIDE EACH BEDROOM WITH BATTERY BACKUP. SMOKE ALARM TO BE PLACED NO LESS THAN 30 HORIZONTALLY FROM A BATHROOM DOOR CONTAINING A BATH TUB/SHOWER.	
EMERGENCY ILLUMINATION	NOT REQUIRED	
MAX TRAVEL DISTANCE TO EXITS	< 75'	
FIRE EXTINGUISHERS	PROVIDED BY OWNER	
LOCAL ORDINANCES	2018-21 International Domestic Dimensional Standards	
MAXIMUM BUILDING COVERAGE:	30% OF SITE	
MAXIMUM IMPERVIOUS SURFACE:	40% OF SITE	

DETAIL CALLOUT



ELEVATION KEY



SECTION KEY



INTERIOR ELEVATION KEY



NORTH INDICATOR



ELEVATION MARKER



SPOT ELEVATION



F.F.E. - FINISH FLOOR ELEVATION




ROOM




GAP ROAD HOUSES - HOME OPTIONS
 LAFAYETTE INVESTMENTS
 3425 GAP ROAD, KNOXVILLE, TN

DATE	02/24/22
PROJECT	21217
DRAWN BY	MSG
CHECKED BY	
DATE	02/24/22

Drawn: MSG
COVER



DATE : 02/24/22
PROJECT : 21217
COPYRIGHT 2021

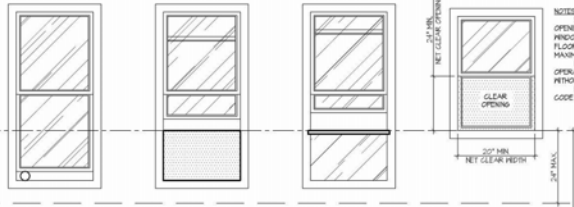

SECTION 1 WINDOW SILL
1. OPERABLE WINDOW WITH OPENING THAT WILL NOT ALLOW 4" DIAMETER SPHERE TO PASS THROUGH AT LARGEST OPEN POSITION

SECTION 2 WINDOW SILL
2. OPERABLE WINDOW PROVIDED WITH WINDOW FALL PREVENTION DEVICES THAT COMPLY WITH ASTM F2092

SECTION 3 WINDOW SILL
3. OPERABLE WINDOW THAT ARE PROVIDED WITH WINDOW OPENING CONTROL DEVICES THAT COMPLY WITH IRC SECTION R602.2.2

E. ELEVATION NOTES

- EXTERIOR FLASHING TO BE CORRECTLY INSTALLED AT ALL CONNECTIONS BETWEEN ROOFS, WALLS, CHIMNEYS, PROJECTIONS, AND PENETRATIONS AS REQUIRED BY APPROVED CONSTRUCTION PRACTICES.
- GENERAL CONTRACTOR TO PROVIDE ADEQUATE ATTIC VENTILATION AND ROOF FLASHING AS APPLICABLE. PROVIDE INSTALL CONTINUOUS RIDGE VENTILATION AND PRIME & PAINT TO CLOSELY MATCH ROOF COLOR IF APPLICABLE. PROVIDE APPROPRIATE SOFFIT VENTILATION AT OVERHANGS.
- ALL PLUMBING AND MECHANICAL VENTS TO BE LOCATED TO THE EXTERIOR WITHIN THE ATTIC SPACE WHEN POSSIBLE TO MINIMIZE THE NUMBER OF ROOF PENETRATIONS. ALL PLUMBING AND MECHANICAL VENTS WHICH APPEAR ABOVE THE ROOF TO BE LOCATED AWAY FROM ANY PROMINENT VIEW. NO VENTS TO BE ALLOWED ON THE FRONT ROOF. ALL METAL AND PVC VENTS AND PENETRATIONS TO BE PRIMED & PAINTED TO CLOSELY MATCH THE ROOF COLOR. (VERIFY WITH OWNER)
- GENERAL CONTRACTOR TO LOCATE UTILITY METERS AWAY FROM ANY PROMINENT VIEW. UTILITY METERS TO BE LOCATED AS CLOSE TO GRADE AS POSSIBLE TO MINIMIZE THE VISUAL IMPACT OF THE METERS.
- GUTTERS AND DOWNSPOUTS ARE NOT INCLUDED ON THE ELEVATION DRAWINGS. GENERAL CONTRACTOR TO VERIFY THE EXISTING TOPOGRAPHIC GRADES, AND LOCATE DOWNSPOUTS TOWARDS FRONT AND REAR OF HOUSE, BASED ON TOPOGRAPHIC CONDITIONS. TO ALLOW POSITIVE DRAINAGE AWAY FROM THE HOUSE. DO NOT LOCATE DOWNSPOUTS IN PROMINENT LOCATIONS. GENERAL CONTRACTOR TO OBTAIN OWNER APPROVAL OF ALL DOWNSPOUT LOCATIONS. GUTTERS AND DOWNSPOUTS TO MATCH TRIM COLOR OF HOUSE, OR, IF APPROPRIATE, DOWNSPOUTS MAY BE COLOR-MATCHED TO PRIMARY ELEVATION MATERIALS. PROVIDE WATER-DISPERSING TRIM AT DOWNER ROOFS, AND GUTTER GUARDS ON ALL GUTTERS.

ENERGY CODE

ATTIC ACCESS HATCHES & DOORS MUST BE WEATHER STRIPPED & INSULATED TO THE SAME LEVEL AS THE SURROUNDING SURFACES.

FLOOR INSULATION MUST BE INSTALLED TO MAINTAIN PERMANENT CONTACT WITH THE UNDERSIDE OF THE SUBFLOOR DECKING.

PROGRAMMABLE THERMOSTATS WITH DAILY SETBACK CAPABILITY REQUIRED WHERE PRIMARY HEATING SYSTEM IS FORCED AIR WITH AN INITIAL SETTING HIGHER THAN 70° FAHRENHEIT FOR HEATING, AND NOT LOWER THAN 78° FAHRENHEIT FOR COOLING.

SUPPLY DUCTS IN ATTICS RETAIN R-4 INSULATION REQUIREMENT REQUIREMENTS FOR ALL OTHER DUCTS IN UNCONDITIONED SPACE REDUCED TO R-6.

THE ENTIRE DUCT SYSTEM MUST BE SEALED

ICC PRESCRIPTIVE REQUIREMENTS	ZONE 4
WINDOWS (U-FACTOR)	0.40
SKYLIGHTS (U-FACTOR)	0.55
CEILING - OPEN ATTIC (R-VALUE)	44
CEILING - CATHEDRAL (R-VALUE)	30
WOOD FRAME WALL (R-VALUE)	20 / 13/5
MASS WALL (R-VALUE)	8 / 13
FLOOR (R-VALUE)	18
BASEMENT WALL (R-VALUE)	10 / 13
SLAB (R-VALUE) 1' DEPTH	10, 2 FT.
GRAVEL SPACE WALL (R-VALUE)	10 / 13

M. MASONRY NOTES

- STONE & MASONRY VENEER SHALL BE INSTALLED IN ACCORDANCE WITH IRC SECTION R703.7.
- BRICKS**
PROVIDE UNIFORMLY SIZED UNITS CONFORMING TO ASTM SPECIFICATIONS SW. TYPE FBS, AND LIMCEMENT MORTAR COMPLYING WITH ASTM SPECIFICATION C77. TYPE S. INSTALL GALVANIZED ANCHORS @ 16" O.C. EACH WAY, WITH CADMIUM-PLATED ROOF FLASHING AS APPLICABLE.
- MASONRY VENEER ANCHORS TO BE GENERAL CONTRACTOR TO REVIEW THE PLANS AND VERIFY THE QUALITY OF WORK. THE ANCHOR TO THE EXTERIOR AS PER I.R.C. SECTION R703.7.4.
- EXTERIOR WALL COVERINGS & BACKING MATERIALS TO MEET WIND LOADS AS PER I.R.C. SECTION R703.
- THE VENEER SHALL BE SEPARATED FROM THE SHEATHING BY AN AIR SPACE OF A MINIMUM OF A NOMINAL (1) INCH, BUT NO MORE THAN 1 1/2".
- FLASHING SHALL BE LOCATED BENEATH THE FIRST COURSE OF MASONRY ABOVE THE FOUNDATION WALL OR SLAB, AND AT OTHER POINTS OF SUPPORT, INCLUDING STRUCTURAL FLOORS, SHELF ANGLES & LINTELS, AS PER I.R.C. SECTION R703.7.6.
- WEEPHOLES SHALL BE PROVIDED IN THE EXTERIOR WALLS OF MASONRY WALLS AT A MAXIMUM SPACING OF 33" O.C. WEEPHOLES SHALL NOT BE LESS THAN 3/4" IN DIAMETER. WEEPHOLES SHALL BE LOCATED IMMEDIATELY ABOVE THE FLASHING AS PER I.R.C. SECTION R703.7.6.

EXTERIOR PLASTER

- EXTERIOR PLASTER SHALL BE INSTALLED IN ACCORDANCE WITH IRC SECTION R703.6.
- LATH PROVIDE ALL LATH & LATH ATTACHMENTS SHALL BE OF CORROSION-RESISTANT MATERIAL. EXPANDED METAL WOVEN WIRE CORROSION-RESISTANT MATERIAL. EXPANDED METAL WOVEN WIRE SHALL BE HEAVY GUAGE, HECA STAPLES, SPACED AT NO MORE THAN 6". OTHERWISE APPROXIMATE 6".
- PLASTER, PLASTERING WITH PORTLAND CEMENT PLASTER SHALL BE NOT LESS THAN (2) COATS WHEN APPLIED OVER METAL LATH OR WIRE, AND SHALL BE NOT LESS THAN (2) COATS WHEN APPLIED OVER MASONRY, CONCRETE, PRESSURE-TREATED TREATED WOOD, OR DECAY-RESISTANT WOOD AS SPECIFIED IN IRC SECTION R703.7.1. OR BACKING, IF THE PLASTER SURFACE IS COMPLETELY COVERED BY VENEER OR OTHER FACING MATERIAL OR IS COMPLETELY CONCEALED. PLASTER APPLICATION NEED BE ONLY (2) COATS, PROVIDED THE TOTAL THICKNESS AS LISTED IN TABLE R703.7.1(1).
- WEEP SCREEDS
A. A MINIMUM 0.125-INCH (26G) GALVANIZED SHEET, CORROSION-RESISTANT WEEP SCREED, OR PLASTIC WEEP SCREED, WITH A MINIMUM VERTICAL ATTACHMENT FLANGE OF 2 1/2". SHALL BE PROVIDED AT OR BELOW THE FOUNDATION PLATE LINE ON EXTERIOR STUD WALLS IN ACCORDANCE WITH ASTM C-926.
B. THE WEEP SCREED SHALL BE PLACED A MINIMUM OF 2" ABOVE THE EARTH OR 2" ABOVE PAVED AREAS, AND SHALL BE OF A TYPE THAT WILL ALLOW TRAPPING WATER TO DRAIN TO THE EXTERIOR OF THE BUILDING.
C. THE WEATHER-RESISTANT BARRIER SHALL LAP THE WEEP SCREED ATTACHMENT FLANGE, THE EXTERIOR LATH SHALL COVER & TERMINATE ON THE ATTACHMENT FLANGE OF THE WEEP SCREED.
- WATER RESISTIVE BARRIERS:**
WATER RESISTIVE BARRIERS SHALL BE INSTALLED IN ACCORDANCE WITH SECTION R703.2, AND, WHERE APPLIED OVER WOOD-BASED SHEATHINGS, SHALL INCLUDE A WATER-RESISTIVE VAPOR-PERMEABLE BARRIER.
B. A WATER-RESISTIVE VAPOR-PERMEABLE BARRIER APPLIED BETWEEN WOOD-BASED SHEATHINGS AND STUDS SHALL BE OF A DRAINAGE TYPE.
- LINTEL SCREED**
FOR 4" BRICK VENEER WITH NO SUPERIMPOSED LOADING.

STEEL LINTELS TO BE SHOP-COATED WITH RUST-INHIBITIVE PAINT, UNLESS MADE OF CORROSION-RESISTANT STEEL OR TREATED WITH A CORROSION-RESISTANT COATING. PAINTING THE EXPOSED SURFACES OF THE LINTEL AFTER INSTALLATION DOES NOT ADEQUATELY PREVENT CORROSION.

SPAN	LINTEL	MIN. BEAR.	REFER.
4'-0" OR LESS	L3-12"x12"x10"	6"	NOTE 1
6'-0"	L4-12"x12"x10"	6"	NOTE 1
8'-0"	L5-12"x12"x10"	6"	NOTE 1
10'-0"	L6-12"x12"x10"	6"	NOTE 1
12'-0" TO 12'-6"	L7-12"x12"x10"	6"	NOTE 2
12'-6" TO 14'-0"	L7-12"x12"x10"	6"	NOTE 2
14'-0"	L8-12"x12"x10"	6"	NOTE 2
16'-0"	L9-12"x12"x10"	10"	NOTE 3

- DESIGNED FOR BRICK LOAD WHERE WIDTH OF OPENING EQUALS HEIGHT OF BRICK.
- DESIGNED FOR A MAXIMUM OF TWENTY (20) BRICK COURSES OVER LINTEL AT GARAGE DOOR.
- DESIGNED FOR GARAGE DOOR WITH BRICK GABLE OVER LINTEL.

DESIGN DATA:

BRCK 2500 PSI
MORTAR TYPE N
STEEL#6

EL. ELECTRICAL NOTES

- ELECTRICAL PLANS) ILLUSTRATE BASIC DESIGN INTENT ONLY. ELECTRICAL CONTRACTOR TO BE RESPONSIBLE FOR ADHERING TO ALL APPLICABLE CODES AND SAFETY REQUIREMENTS. VERIFY FIXTURE SELECTION AND LOCATION WITH OWNER.
- LIGHT FIXTURES TO BE INSTALLED AS CLOSE AS POSSIBLE TO THE LOCATION SHOWN ON THE ELECTRICAL PLANS). LIGHT FIXTURES TO ALIGN WITH OTHER LIGHT FIXTURES, OR WITH ADJACENT HYAC SARK AND RAGS.)
- GENERAL CONTRACTOR AND ELECTRICAL SUBCONTRACTOR TO REVIEW THE PLANS AND VERIFY THE QUALITY OF WORK. THE ARCHITECT THAT THE DESIGN INTENT IS MAINTAINED. GENERAL CONTRACTOR TO NOTIFY THE ARCHITECT IF ANY ITEMS ARE DIFFERENT FROM THE ELECTRICAL PLANS) BEFORE THE INSTALLATION OF FIXTURES.
- GAS OR ELECTRICAL SERVICE TO BE PROVIDED AS REQUIRED FOR ALL DISPOSALS AND EQUIPMENT SUCH AS REFRIGERATOR, FREEZER, DISHWASHER, WASHER, DRYER, HYAC EQUIPMENT, ALARM ETC. PROVIDE OUTLET ABOVE RANGE FOR MICROWAVE OR HOOD VENT IF FINAL KITCHEN LAYOUT REQUIRES.
- ALL OUTLETS LOCATED NEAR ANY WATER CONDITION TO BE G.F.I. TYPE SWITCHES AND OUTLETS TO BE COORDINATED WITH THE OWNER, AND GENERAL CONTRACTOR TO VERIFY THE PROVIDE WATERPROOF OUTLETS AS PER PLANS.)
- GENERAL CONTRACTOR TO VERIFY WITH THE OWNER, ALL LOCATIONS OF PHONE OUTLETS, COMPUTER OUTLETS, AND ELECTRONIC DEVICE OUTLETS. ALL OUTLETS LOCATED NEAR ANY WATER DEDICATED CIRCUIT.
- GENERAL CONTRACTOR TO VERIFY WITH THE OWNER, THE LOCATIONS OF CABLE TV DIMMERS TO BE SIZED FOR THE APPROPRIATE LOAD OF THE FIXTURES AND LAMPS SELECTED. SLIDE TYPE DIMMERS ARE PREFERRED.
- VERIFY TRIM SIZE FOR ALL DOORS AND WINDOWS TO TRIM, AND ALIGN WITH EACH OTHER IF THERE ARE MULTIPLE SWITCHES.
- BLOCK AND PREWIRE SEPARATE SWITCHES TO EACH LIGHT AND CEILING FAN.
- GENERAL CONTRACTOR TO VERIFY WITH THE ARCHITECT AND/OR LANDSCAPE ARCHITECT, ALL LANDSCAPE AND EXTERIOR LIGHTING CIRCUITS AND SWITCHES.
- GENERAL CONTRACTOR TO VERIFY WITH THE OWNER WHETHER EXTERIOR SECURITY LIGHTS ARE DESIRED. IF SO, GENERAL CONTRACTOR TO VERIFY THE TYPE OF FIXTURE, LOCATION, AND REQUIRED SWITCHING.
- GENERAL CONTRACTOR TO COORDINATE ALL THE REQUIREMENTS OF AN ALARM SYSTEM, IF ONE IS DESIRED. PROVIDE HARROWED SMOKE DETECTORS, WITH BATTERY BACKUP, ON ALL FLOORS AND IN EACH BEDROOM. VERIFY WITH LOCAL CODE REQUIREMENTS.
- VERIFY FOR HYAC UNITS), NUMBER OF UNITS TO BE DETERMINED BY THE LOCAL MECHANICAL CONTRACTOR.
- HYAC UNITS ARE NOT TO BE WIREDED NEXT TO MASTER BEDROOM OR PATIO/DECK AREAS.
- LOCAL VENTILATION
A. PROVIDE 60 CFM VENTILATION FAN (MINIMUM FOR EACH BATHROOM & LAVATORY)
B. PROVIDE 100 CFM VENTILATION FAN AT KITCHEN RANGE HOOD
- EXISTING PANEL BOX MAY REQUIRE RELOCATION; PANEL BOX TO BE SIZED TO ACCOMMODATE ALL CALCULATED LOADS, AND PROVIDE FOR A MINIMUM OF EIGHT (8) SPACES.
- DECORATIVE LIGHT FIXTURES TO BE SELECTED BY THE OWNER, AND COORDINATED WITH THE GENERAL CONTRACTOR. THE OWNER TO APPROVE ALL SUBSTITUTIONS.
- GENERAL CONTRACTOR TO COORDINATE THE LAMP SELECTION (RECESSED CAN SIZE AND TRIM) WITH THE OWNER. ELECTRIC AND GAS METERS TO BE LOCATED AWAY FROM ANY PROMINENT VIEW. VERIFY WITH LOCAL UTILITY.

W. WOOD DECK NOTES

- ALL CONSTRUCTION SHALL BE PER INTERNATIONAL RESIDENTIAL BUILDING CODE.
- DECK LOADS ARE 40 LB LIVE LOAD AND 10 LB DEAD LOAD. ANY SPECIAL LOADS SHOULD BE CONSIDERED AS WELL.
- THE GENERAL CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND SITE CONDITIONS BEFORE STARTING WORK. THE ARCHITECT/ENGINEER SHALL BE NOTIFIED OF ANY DISCREPANCY. GENERAL CONTRACTOR SHALL USE SHIMRON (STRONG-TIE) (OR APPROVED EQUAL) "STRONG-TIE" OR APPROVED EQUAL) GENERAL CONTRACTOR AND ELECTRICAL SUBCONTRACTOR TO REVIEW THE PLANS AND VERIFY THE QUALITY OF WORK. THE ARCHITECT THAT THE DESIGN INTENT IS MAINTAINED. GENERAL CONTRACTOR TO NOTIFY THE ARCHITECT IF ANY ITEMS ARE DIFFERENT FROM THE ELECTRICAL PLANS) BEFORE THE INSTALLATION OF FIXTURES.
- CONCRETE ANCHORS AND POST BASE CONNECTORS SHALL BE GALVANIZED WITH 1.85 oz/sq OF ZINC (G-185 COATING) OR STAINLESS STEEL. ALL HARDWARE AND FASTENERS (NAILS, HANGERS, POST ANCHORS, MECHANICAL FASTENERS, NAILS, SCREWS, BOLTS, ETC) SHALL BE GALVANIZED WITH 1.85 oz/sq OF ZINC (G-185 COATING) OR SHALL BE STAINLESS STEEL. LOOK FOR PRODUCTS SUCH AS ZMAX FROM SIMPSON-STRONG-TIE OR "TRIPLE ZINC" FROM US.
- UNLESS NOTED OTHERWISE IN THESE DETAILS, ALL FRAMING LUMBER SHALL BE SOUTHERN PINE, GRADE #2 OR BETTER AND SHALL BE PRESURE TREATED ACC OR C4-B IN ACCORDANCE WITH AMERICAN WOOD PRESERVERS ASSOCIATION STANDARDS. ALL LUMBER IN CONTACT WITH THE GROUND SHALL BE RATED AS "GROUND CONTACT". PLEASE NOTE THAT NOT ALL TREATED LUMBER IS RATED FOR GROUND CONTACT.
- ALL DECKING MATERIAL SHALL BE 2x6 OR 5/4 FIVE-QUARTER BOARD ATTACH DECKING TO EACH JOIST WITH A MINIMUM OF (2) RING SHANK NAILS OR 2-1/2" WOOD SCREWS. DECKING MAY BE APPLIED DIAGONALLY AT A 45 DEGREE ANGLE PERPENDICULAR TO THE JOISTS. DECKING COMPOSED OF FOREIGN LUMBER COMPOSITE OR MANUFACTURED MATERIALS MAY BE SUBSTITUTED ONLY WHEN THE PRODUCT HAS AN APPROVED EVALUATION REPORT FROM AN ACCREDITED TESTING LABORATORY CHECK WITH YOUR LOCAL BUILDING DEPARTMENT FOR APPROVED MATERIALS OR REFER TO THE LIST OF APPROVED DECKING PRODUCTS. FOR STAIRS & GUARDRAILS, SEE "STAIRS & RAILINGS," WITHIN FRAMING NOTES.


FASTENING SCHEDULE		
CONNECTION	FASTENER	LOCATION
JOIST TO SILL OR GIRDER	4-1/8 COMMON	TOE NAIL PER JOIST
BRIDGING TO JOIST	2-8D COMMON	TOE NAIL EACH END
SOLE PLATE TO JOIST OR BLOCKING	3-1/8 812" O.C.	TYPICAL FACE NAIL
TOP PLATE TO STUD	2-1/8D COMMON	END NAIL
STUD TO SOLE PLATE	4-8D COMMON	TOE NAIL
	2-1/8D COMMON	END NAIL
DOUBLE STUDS	2-1/8 812" O.C.	FACE NAIL
DOUBLE TOP PLATES	2-1/8 24" O.C.	TYPICAL FACE NAIL
DOUBLE TOP PLATES	8-1/8D COMMON	LAP SPLICE
BLOCKING BETWEEN JOISTS OR RAFTERS TO TOP PLATE	2-1/8D COMMON	TOE NAIL EACH END
RM JOIST TO TOP PLATE	3-1/8 812" O.C.	TOE NAIL
TOP PLATES, LAPS & INTERSECTIONS	5-1/8D COMMON	BLOCKING TO JOIST (END NAILED) 4-1/8D PER JOIST BAND JOIST TO SILL OR TOP PLATE (TOE NAILED) 4-1/8D ON BLOCK
CONTINUOUS HEADER, TWO PIECES	1/8D COMMON @ 16" O.C.	ALONG EDGE
CEILING JOISTS TO PLATE	4-1/8D COMMON	TOE NAIL
CONTINUOUS HEADER TO STUD	4-1/8D COMMON	TOE NAIL
CEILING JOISTS, HPS OVER PARTITIONS	4-1/8D COMMON MINIMUM	FACE NAIL
CEILING JOISTS, PARALLEL TO RAFTERS	4-1/8D COMMON MINIMUM	FACE NAIL
RAFTER TO PLATE, HURDING CLIPS	3-1/8D COMMON	TOE NAIL
BUILT-UP CORNER STUDS	2-1/8D COMMON @ 24" O.C.	FACE NAIL
BUILT-UP GIRDER & BEAMS	2/8D COMMON @ 24" O.C.	FACE NAIL AT TOP & BOTTOM, STAGGERED ON OPPOSITE SIDES
	2-2/8D COMMON	FACE NAIL AT ENDS & AT EACH SPLICE
COLLAR TIE TO RAFTER	5-1/8D COMMON	FACE NAIL
JACK RAFTER TO HP	3-1/8D COMMON	TOE NAIL
ROOF RAFTER TO 2x-RIDGE BEAM	2-1/8D COMMON	TOE NAIL
JOIST TO BAND JOIST	4-1/8D COMMON	FACE NAIL
LEDGER STRIP	3-1/8D COMMON PER FOOT	FACE NAIL
WOOD STRUCTURAL PANELS & PARTICLE BOARD	1/8 LESS	1/8D COMMON @ O.C. EDGE SPACING 12" O.C. FIELD SPACING
SUBFLOOR, ROOF, & WALL SHEATHING (TO FRAMING)		
SINGLE FLOOR (COMBINATION SUBFLOOR UNDERLAYMENT TO FRAMING)		
PANEL BONDING TO FRAMING	1/8 LESS	1/8D COMMON @ O.C. EDGE SPACING 12" O.C. FIELD SPACING
FIBERBOARD SHEATHING	1/8	1/8D ROOFING @ O.C. EDGE SPACING 12" O.C. FIELD SPACING



GAP ROAD HOUSES - HOME OPTIONS
LAFAYETTE INVESTMENTS
3425 GAP ROAD, KNOXVILLE, TN

DATE	02/24/22
PROJECT	21217
SCALE	AS SHOWN
DESIGNER	MSG
CHECKER	GENERAL

Drawn: MSG
GENERAL



DATE : 02/24/22
PROJECT : 21217

INFILL CHECKLIST
FRONT YARDS - SECTION 1, PAGE 6

- N/A SETBACK AND FRONT DOOR ARE IN LINE AND CONSISTENT WITH ORIGINAL HOUSES ON THE BLOCK.
- X PORCH AND HABITABLE PORTION OF THE HOUSE IS OFFSET FROM STREET EQUAL TO NEIGHBORING HOUSES.
- N/A WALKWAY IS PROPOSED FROM SIDEWALK WHEN AVAILABLE TO FRONT DOOR, PERPENDICULAR TO STREET.
- N/A FENCING IS CONSTRUCTED OF TRADITIONAL MATERIALS AND EXCLUDES CHAIN LINK, MASONRY, WIDE BOARDS, AND OTHER CONTEMPORARY MATERIALS.
- X HEALTHY TREES ARE MARKED FOR PRESERVATION.

HOUSE ORIENTATION AND SIDE YARDS - SECTION 2, PAGE 6

- N/A PROPOSED INFILL IS PROPORTIONAL TO DIMENSION OF LOT AND ORIGINAL HOUSES ON THE BLOCK.
- N/A PROPOSED INFILL ON CORNER LOTS HAS APPLIED FOR ANY NECESSARY ZONING VARIANCE TO LOCATE CLOSER TO SIDE STREET.
- N/A PROPOSED INFILL KEEPS THE SPACING BETWEEN HOUSES CONSISTENT WITH ORIGINAL HOUSES ON THE BLOCK.

ALLEYS, PARKING AND SERVICES - SECTION 3, PAGE 7

- X PROPOSED PARKING AVOIDS THE FRONT YARD.
- N/A PROPOSED INFILL HOUSE HAS ACCESS FROM ALLEY ONLY (WHERE AVAILABLE) FOR GARAGE OR PARKING PAD. IF NO ALLEY EXISTS, PROPOSED GARAGE OR PARKING PAD EXTENDS 20' BEYOND THE FRONT FACADE OF PROPOSED INFILL HOUSE.
- N/A PROPOSED GARAGES ACCESSED BY ALLEY ARE SETBACK AT LEAST 18' FROM CENTERLINE OF ALLEY PAVEMENT.
- X PROPOSED PARKING PADS, UTILITY BOXES, AND WASTE COLLECTION POINTS ARE VISUALLY SCREENED BY LANDSCAPING AND/OR FENCING.

SCALE, MASS & FOUNDATION HEIGHT - SECTION 4, PAGE 8

- N/A PROPOSED INFILL ELEVATION IS PROPORTIONAL IN SCALE TO THE ORIGINAL HOUSES ON THE BLOCK.
- N/A PROPOSED INFILL FACADE RESPECTS THE WIDTHS OF OLDER HOUSES ON THE BLOCK.
- N/A PROPOSED INFILL ATTEMPTS TO INCORPORATE HISTORIC ELEMENTS OF THE BLOCK INTO THE DESIGN.
- N/A FOUNDATION HEIGHT IS CONSISTENT WITH ORIGINAL HOUSES ON THE BLOCK.
- N/A ADDITIONS THAT CANNOT CONFORM TO SCALE AND HEIGHT OF STREETSIDE ARE LOCATED TO THE SIDE OR REAR OF INFILL LOT.

PORCHES AND STOOPS - SECTION 5, PAGE 9

- X PROPOSED INFILL INCLUDES PLANS FOR A PORCH IN A NEIGHBORHOOD WHERE PORCHES ARE DOMINANT.
- X PROPOSED PORCH IS PROPORTIONAL TO EXISTING PORCHES ON BLOCK.
- X PROPOSED PORCH MAINTAINS CONSISTENCY WITH EXISTING PORCHES IN SETBACK ALONG THE STREET.
- X PROPOSED PORCH MATERIALS AND DETAILS COMPLEMENT THE HISTORIC CHARACTER AND STYLE OF NEIGHBORHOOD (APPENDIX C).

WINDOWS & DOORS - SECTION 6, PAGE 10

- X PROPOSED WINDOW AND DOOR STYLES COMPLEMENT HISTORIC CHARACTER AND STYLE OF BLOCK (REFER TO APPENDIX).
- X PROPOSED WINDOW OR DOOR POSITIONING DOES NOT VIOLATE THE PRIVACY OF NEIGHBORING HOMES.
- N/A PROPOSED INFILL EXCLUDES CONTEMPORARY WINDOW STYLES IN PRE-1940 AREAS.
- N/A PROPOSED INFILL RESPECTS WINDOW AND DOOR PLACEMENT OF OLDER HOUSES ON THE BLOCK.

ROOF SHAPES & MATERIALS - SECTION 7, PAGE 12

- X PROPOSED INFILL SPECIFICS SIMILAR PITCH TO EXISTING HOUSES ON BLOCK.
- N/A PROPOSED INFILL RESPECTS COMPLEX ROOF FORMS OF HISTORIC BLOCKS.
- N/A PROPOSED INFILL FOR A PRE-1940 NEIGHBORHOOD SPECIFICS DARKER SHADES OF SINGLE ROOFING.

SIDING MATERIALS - SECTION 8, PAGE 13


- N/A IN A NEIGHBORHOOD DOMINATED BY PAINTED WOOD SIDING, THE PROPOSED INFILL SPECIFICS CLAPBOARD OR SIMILAR SUBSTITUTES.
- X IN A NEIGHBORHOOD WITH MIXED ARCHITECTURAL STYLES, THE PROPOSED INFILL SPECIFICS APPROPRIATE MATERIAL AND DETAIL.
- X THE PROPOSED INFILL EXCLUDES FACED STONE, VERTICAL SIDING, AND OTHER NON-HISTORIC MATERIALS.

ADDITIONS - N/A

MULTIUNIT HOUSING - N/A

LANDSCAPE & OTHER CONSIDERATIONS - N/A

3 Architectural Site Plan
 A100 1" = 20'-0"

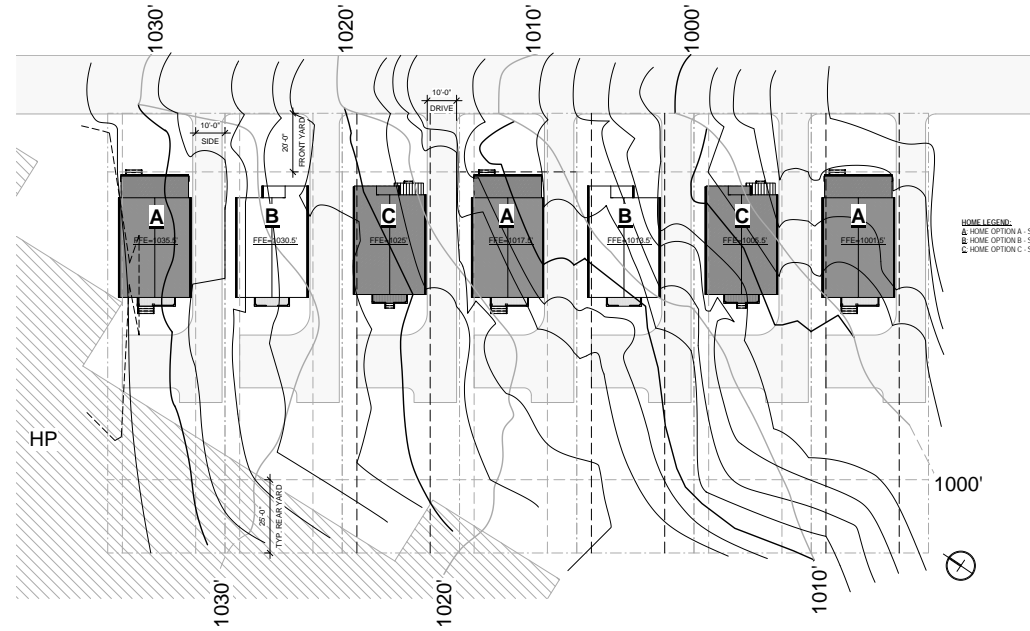

HOME LEGEND:
 A HOME OPTION A - SEE 'X' SHEETS
 B HOME OPTION B - SEE 'B' SHEETS
 C HOME OPTION C - SEE 'C' SHEETS


FRONT YARD: 20' SETBACK
 SIDE YARD: 10' TOTAL, MIN. ONE SIDE 5'
 REAR YARD: 20' SETBACK

HOME TYPE A
 TOTAL LOT: 6,000 SF
 PAVED: 1,457 SF
 HOME: 708 SF
 36% HARD SURFACE
 64% PERMEABLE

HOME TYPE B
 TOTAL LOT: 6,000 SF
 PAVED: 1,457 SF
 HOME: 701 SF
 37% HARD SURFACE
 63% PERMEABLE

HOME TYPE C
 TOTAL LOT: 6,000 SF
 PAVED: 1,457 SF
 HOME: 770 SF
 37% HARD SURFACE
 63% PERMEABLE

1 Site Setbacks & Layout
 A100 1" = 20'-0"

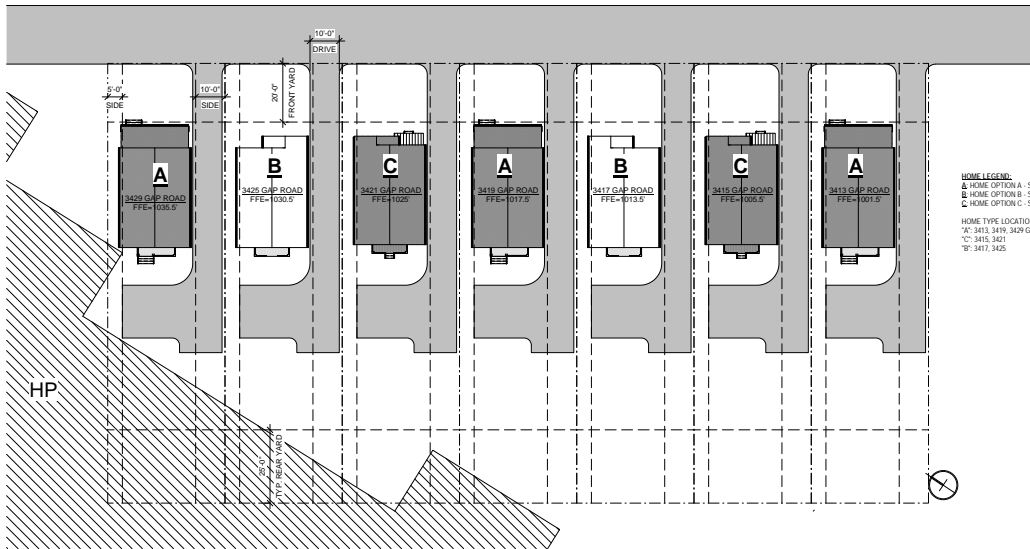

HOME LEGEND:
 A HOME OPTION A - SEE 'X' SHEETS
 B HOME OPTION B - SEE 'B' SHEETS
 C HOME OPTION C - SEE 'C' SHEETS

HOME TYPE LOCATIONS:
 'A': 3413, 3419, 3429 GAP ROAD
 'B': 3415, 3421
 'C': 3417, 3425



NO. OF SHEETS	NO. OF SHEETS
NO. OF SHEETS	NO. OF SHEETS
NO. OF SHEETS	NO. OF SHEETS
NO. OF SHEETS	NO. OF SHEETS

Drawn: MSG
 ARCHITECTURAL SITE PLAN




GAP ROAD HOUSES - HOME OPTIONS
LAFAYETTE INVESTMENTS
 3425 GAP ROAD, KNOXVILLE, TN

DATE	11/19/21
PROJECT	21217
DRAWN BY	MSG
CHECKED BY	MSG
DATE	11/19/21


Drawn: MSG
 HOME OPTION B - FLOOR PLANS

B-103


DATE: 11/19/21
 PROJECT: 21217
 © COPYRIGHT 2021

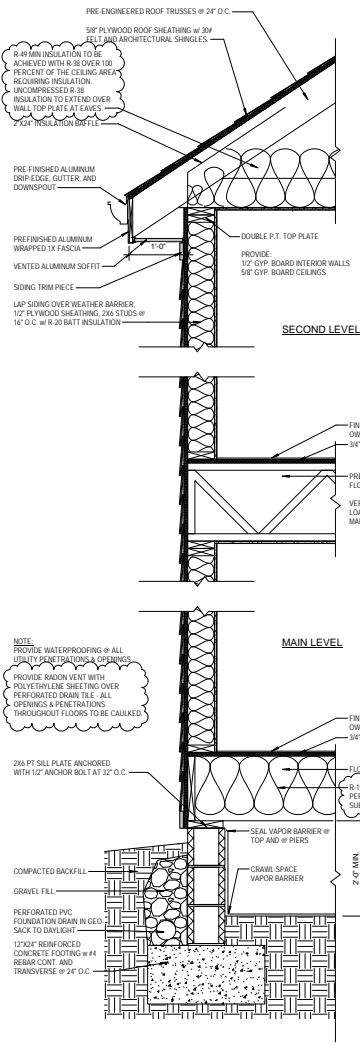


3 Typical Wall Section
 T = 1'-0"

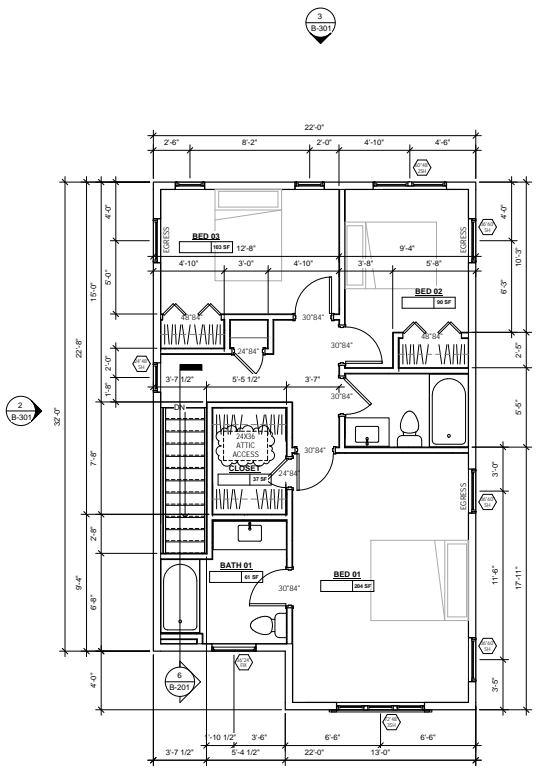


2 02 - Second Level
 T/4' = 1'-0"

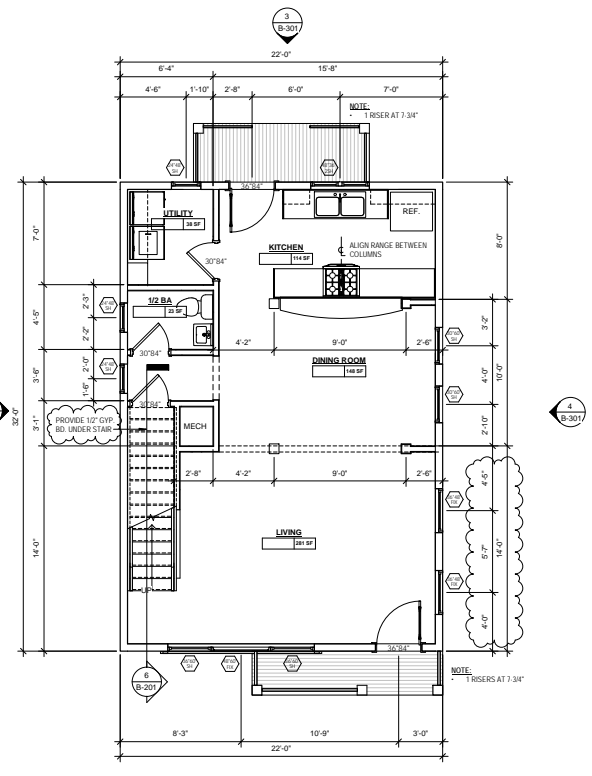

1 01 - Main Level
 T/4' = 1'-0"

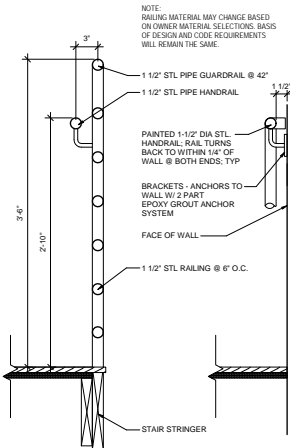


7 Railing Details
8-201 1 1/2" = 1'-0"

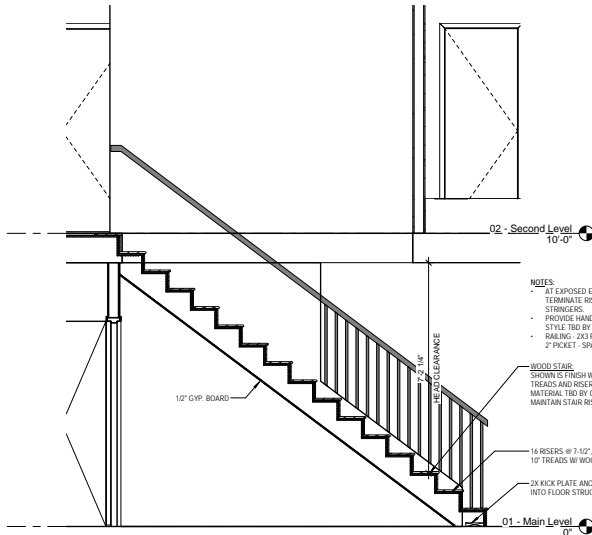

6 Stair Section
8-201 1/2" = 1'-0"

- NOTES:
- AT EXPOSED END LOCATIONS (NOT AT WALLS) TERMINATE RISERS AND TREADS AT FINISHED STRINGERS.
 - PROVIDE HANDRAIL 3/4" ABOVE TREAD. STYLE TBD BY OWNER.
 - RAILING - 2X3/4" WOOD TOP & BOTTOM WITH 2" PICKET - SPACING @ 3 7/8" CLEAR. MAX.
 - WOOD STAIR: SHOWN IS FRESH WOOD FLOORING OVER PLYWOOD TREADS AND RISERS. FINISH FRESH SURFACE MATERIAL TBD BY OWNER. MAINTAIN STAIR RISE & RUN REQUIREMENTS.
 - 18 RISERS @ 7 1/2". 10' TREADS W/ WOOD NOSING.
 - 2X DECK PLATE ANCHORED INTO FLOOR STRUCTURE.

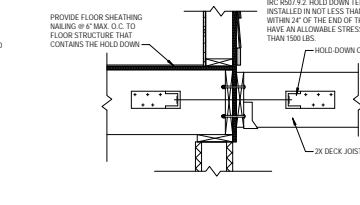


5 Deck Attachment Detail
8-201 1" = 1'-0"

LATERAL LOADS SHALL BE TRANSFERRED TO THE GROUND. PROVIDE LATERAL LOAD CONNECTION IN ACCORDANCE WITH IRC 602.7.2. HOLD DOWN TENSION DEVICES SHALL BE INSTALLED IN NOT LESS THAN TWO LOCATIONS PER DECK WITHIN 2' OF THE END OF THE DECK. EACH DEVICE SHALL HAVE AN ALLOWABLE STRESS DESIGN CAPACITY OF NOT LESS THAN 1500 LBS.


TYPICAL BLOCKING NOTE:
PROVIDE WOOD BLOCKING IN THE WALL AS REQUIRED TO SUPPORT & ATTACH ALL WALL FINISH ITEMS SUCH AS CABINETS, BRACKETS, HAND RAIS, ETC.
THE BLOCKING & ITS ATTACHMENTS SHALL CARRY THE MINIMUM WEIGHT, VERIFY WITH MANUFACTURER.

TYPICAL WINDOW NOTE:
TEMPERATURES REQUIRED PER THE INTERNATIONAL RESIDENTIAL CODE 2018 IN THE FOLLOWING INSTANCES:
RIBB 4.2 GLAZING ADJACENT TO DOORS
RIBB 4.3 GLAZING IN WINDOWS
ITEM 2: THE BOTTOM EDGE OF THE GLAZING IS LESS THAN 18" ABOVE THE FLOOR
RIBB 4.5 GLAZING AND WET SURFACES


TYPICAL DECKS, PATIOS & PORCHES:
DECKS, PATIOS & PORCHES TO BE 1/2" BELOW ADJACENT FINISHED FLOOR. FLASHING AT ALL FLOOR TRANSITIONS AT DECK, PATIOS & PORCHES.
PROVIDE FOUNDATION VENTS PER IRC RIBB.2 AND 18"x24" CRAWL SPACE ACCESS PER IRC REQUIREMENTS. LOCATE BASED ON SITE TOPO.

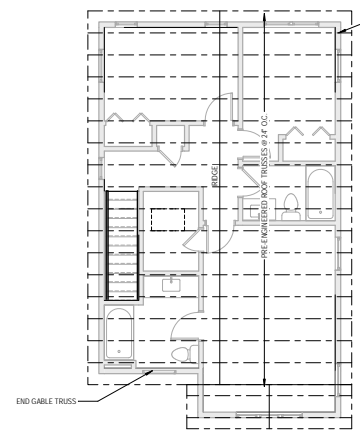


4 Roof Framing Plan
8-201 3/16" = 1'-0"

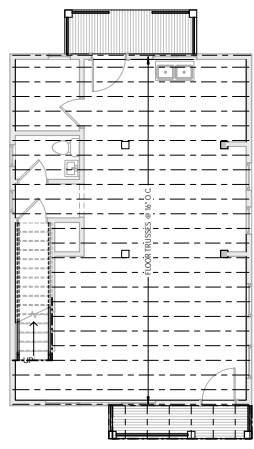

3 Second Floor Framing Plan
8-201 3/16" = 1'-0"

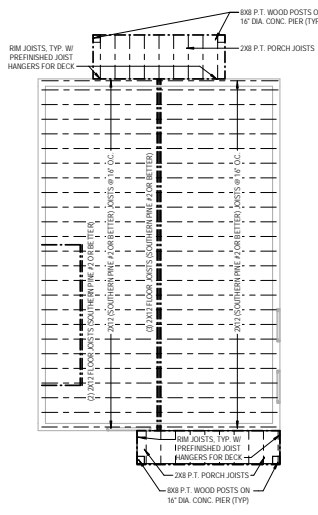

2 First Floor Framing Plan
8-201 3/16" = 1'-0"

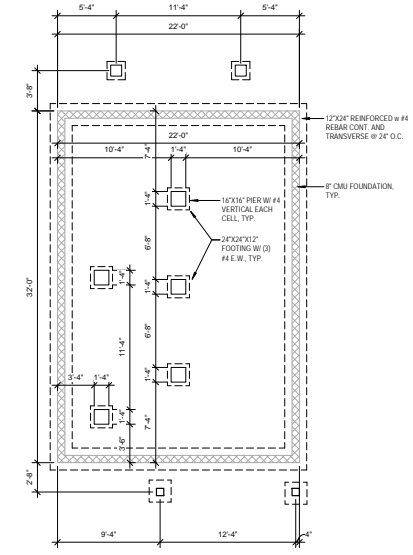

1 Home B - Foundation Plan
8-201 3/16" = 1'-0"

DATE	11/19/21
PROJECT	21217
DESIGNER	MSG
DATE	11/19/21
PROJECT	21217

Drawn: MSG
HOME OPTION B - FRAMING PLANS

B-201

DATE : 11/19/21
PROJECT : 21217
© COPYRIGHT 2021




GAP ROAD HOUSES - HOME OPTIONS
LAFAYETTE INVESTMENTS
 3425 GAP ROAD, KNOXVILLE, TN

DATE	11/19/21
PROJECT	21217
DESIGNED BY	MSG
CHECKED BY	MSG
DATE	11/19/21

Drawn: MSG
 HOME OPTION B - EXTERIOR ELEVATIONS

B-301

DATE : 11/19/21
 PROJECT : 21217
 © COPYRIGHT 2021

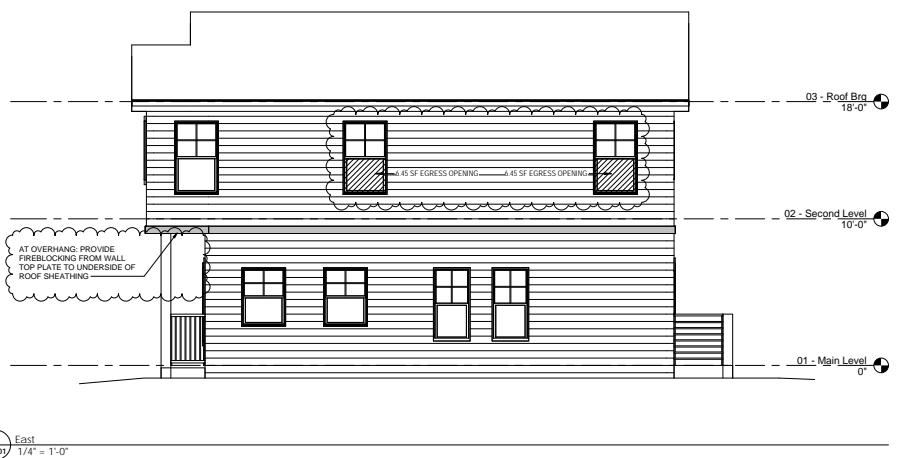

GENERAL NOTE:
 APPROXIMATE SITE LOCATION AND TOPOGRAPHY SHOWN. C.E. TO WORK WITH CIVIL AND STRUCTURAL TEAM TO CLARIFY HOME LOCATIONS, RETAINING REQUIREMENTS, AND F.E. OF EACH HOME BASED ON THE PROPOSED ARCHITECTURAL SITE. CONFIRM ANY HOME ADJUSTMENTS WITH ARCHITECT BASED ON LOCATION WITHIN SETBACK REQUIREMENTS, AND ANY CITY, CODE, OR SEPTIC REQUIREMENTS PRIOR TO ANY PERMIT SUBMISSION.
 WOOD SIDING, SHEATHING, FRAMING, WOOD SIDING, SHEATHING AND WALL FRAMING ON THE EXTERIOR OF A BUILDING HAVING A CLEARANCE OF LESS THAN 6 INCHES FROM THE GROUND OR LESS THAN 2 INCHES MEASURED VERTICALLY FROM CONCRETE STEPS, PORCH SLABS, PATIO SLABS AND SIMILAR HORIZONTAL SURFACES EXPOSED TO THE WEATHER SHALL BE PROVIDED IN THE FOLLOWING LOCATIONS BY THE USE OF NATURALLY DURABLE WOOD OR WOOD THAT IS PRESERVATIVE TREATED IN ACCORDANCE WITH AWPA U1 (2017).

