

File Number: 5-D-25-IH

**Meeting:** 5/21/2025  
**Applicant:** Amber Culpepper Lafayette Properties  
**Owner:** Amber Culpepper Lafayette Properties  
**District:** Lonsdale Infill Housing Overlay District

---

### Property Information

**Location:** 920 Texas Ave. **Parcel ID:** 81 H F 019  
**Zoning:** RN-2 (Single-Family Residential Neighborhood)  
**Description:**  
New primary structure.

---

### Description of Work

Level III New Primary Structure

New primary structure fronting Texas Avenue. One-story residence features a front-gable roof (6/12 pitch) clad in asphalt shingles with overhanging eaves, an exterior of vinyl lap siding, and a block foundation. The house is 28' wide by 36' deep and is proposed to be set 37.5' from the front lot line. It features a half-length 8' deep front porch recessed under a projecting front-gable massing and supported by two 6" square posts made of pressure-treated wood. Parking is a concrete pad (dimensions unspecified) in front of the house and is accessed via Texas Avenue.

The façade (west) features three bays, with paired windows flanking the porch and paneled door in the central bay. The gable fields of the porch and the main massing are clad in vertical siding. The left elevation features three windows, and the right elevation features two windows. The rear elevation features a secondary entrance with a concrete deck and two windows. All windows are 1/1 and single-hung.

---

### Applicable Design Guidelines

Heart of Knoxville Infill Housing Design Guidelines

#### 1. Front Yards

- Consistent front yard space should be created along the street with the setback of a new house matching the older houses on the block.
- A walkway should be provided from the sidewalk or street to the front door. Along grid streets, the walk should be perpendicular to the street.
- Healthy trees that are outside the building footprint should be preserved. The root area should be marked and protected during construction.

#### 2. Housing Orientation

- New housing should be proportional to the dimensions of the lot and other houses on the block.
  - On corner lots, side yard setbacks should be handled traditionally (that is, closer to the side street). The zoning
-

requirement to treat corner lots as having two frontages should not apply in Heart of Knoxville neighborhoods.

- Side yard setbacks should be similar to older houses on the block, keeping the rhythm of spacing between houses consistent.

### 3. Alleys, Parking, and Services

- Parking should not be in front yards.
- Alley access should be used for garage or parking pad locations. On level ground, pea gravel or similar material may be used as a parking pad off alleys.
- On streets without alleys, garages or parking pads should be at least 20 feet behind the front façade of the infill house with access limited to one lane between the street and the front façade.
- Garages which are perpendicular to the alley should be about 18 feet from the center line of the alley pavement, allowing a comfortable turning radius for a driver to enter a garage.
- Alley-oriented parking pads, garbage collection points, and utility boxes should be screened with a combination of landscaping and fencing.
- On those streets which have alleys, driveways should not be permitted from the front of the house.
- On corner lots, a driveway to the garage may be provided off the side street.

### 4. Scale, Mass, and Foundation Height

- The front elevation should be designed to be similar in scale to other houses along the street.
- The front façade of new houses should be about the same width as original houses on the block.
- New foundations should be about the same height as the original houses in the neighborhood.
- If greater height is to be created (with new construction or an addition), that portion of the house should be located toward the side or rear of the property.

### 5. Porches and Stoops

- Porches should be part of the housing design in those neighborhoods where porches were commonplace.
- Porches should be proportional to original porches on the block, extending about 8-12 feet toward the street from the habitable portion of the house.
- Porches should extend into the front yard setback, if necessary, to maintain consistency with similarly sited porches along the street.
- Porch posts and railings should be like those used in the historic era of the neighborhood's development. Wrought iron columns and other materials that were not used in the early 1900's should not be used.
- Small stoops centered on entry and no more than 5 feet deep are appropriate on blocks where porches were not traditional.

### 6. Windows and Doors

- When constructing new houses, the window and door styles should be similar to the original or historic houses on the block.
- To respect the privacy of adjacent properties, consider the placement of side windows and doors.
- The windows and doors on the front facade of an infill house should be located in similar proportion and position as the original houses on the block.
- Attention should be paid to window placement and the ratio of solid (the wall) to void (the window and door openings).
- Contemporary windows such as "picture windows" should not be used in pre-World War II neighborhoods.

### 7. Roof Shapes and Materials

- New roofs should be designed to have a similar pitch to original housing on the block
- More complex roofs, such as hipped roofs and dormers, should be part of new housing designs when such forms were historically used on the block.
- Darker shades of shingle were often used and should be chosen in roofing houses in Heart of Knoxville neighborhoods.

## 8. Siding Material

- Clapboard-like materials (such as cement fiberboard) should be used in constructing new housing where painted wood siding was traditionally used.
- Brick, wood shingle, and other less common material may be appropriate in some older neighborhoods, particularly those with a mix of architectural styles.
- Faced stone, vertical siding, and other non-historic materials should not be used in building new houses. In 1930-1950 era neighborhoods, faced stone may be appropriate (see Section 12).

## 11. Landscape and Other Considerations

- One native or naturalized shade tree should be planted in the front and rear yards of in fill lots with 25 feet or more in depth to front of house

---

## Comments

1. The house is proposed to be set at 37.5' from the front lot line, with the porch at 29.5.' The blockface to receive new construction contains vacant lots and one house, which is set 38' from the front lot line. The proposed setback is appropriate. The final site plan should include a walkway from the front porch to the street.
2. The block to receive lacks significant context, as it only contains two houses, which are infill construction. Other blocks on Texas Avenue feature Minimal Traditionals, Shotguns, and modified Queen Anne cottages. The 28' wide by 36' deep house is proportionate to the lot and to nearby houses.
3. Infill Housing design guidelines recommend that parking be accessed from the alley, if there is one. Parking is a concrete pad located in the front yard and accessed from Texas Avenue. Parking should be revised to avoid the front yard and be accessed from the rear alley, and the final site plan should meet City Engineering standards.
4. The one-story, three-bay façade is similar in scale and height to the context.
5. The house features a half-length, 8' deep front porch recessed under a projecting front-gable massing and supported by two 6" square posts made from pressure-treated wood, which meets the design guidelines.
6. Guidelines recommend window and door styles be similar to historic houses on the block, with similar placement and ratio of solid to void. The 1/1 single-hung windows and paneled door are appropriate for the context, and all elevations feature sufficient transparency.
7. The 6/12 pitch roof is the minimum typically recommended by the guidelines and is appropriate for the context. The design benefits from the roof trim and eave overhangs, which should be retained.
8. The asphalt shingles and vinyl lap siding meet the design guidelines. The block foundation should be clad in stucco or parge-coated to meet design guidelines. The final siding material should feature an overlap, as opposed to Dutch lap or flush panel siding.
9. The site plan indicates a "new ornamental tree" in the front and rear yards. It should be noted that the design guidelines state that "healthy trees that are outside the building footprint should be preserved," and that the lot was entirely clear cut prior to the application.
10. The applicant is proposing two additional houses adjacent to this one, which are differentiated by variations to the front porch design. The Board should discuss whether any additional differentiation is necessary.

## Recommendation

Staff recommends approval of Certificate 5-D-25-IH, subject to the following conditions: 1) the final site plan to meet City Engineering standards; 2) the final site plan to include a walkway from the front porch to the street; 3) parking to be revised to meet design guidelines; and 4) the foundation to be parge-coated or clad in stucco.



**DESIGN  
REVIEW  
BOARD**

**5-D-25-IH**  
**APPLICATION FOR CERTIFICATE OF APPROPRIATENESS**




**920 Texas Ave.**  
**Lonsdale Infill Housing Overlay District**

Original Print Date: 5/7/2025  
Knoxville - Knox County Planning - Design Review Board

Revised:

**Petitioner: Amber Culpepper Lafayette Properties**

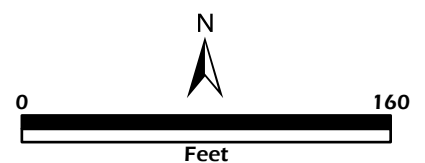



## DESIGN REVIEW REQUEST

☐ DOWNTOWN DESIGN (DK)

☐ HISTORIC ZONING (H)

☒ INFILL HOUSING (IH)

Amber Culpepper, Lafayette Properties

Applicant

05/02/2025

05/21/2025

5-D-25-IH

Date Filed

Meeting Date (if applicable)

File Number(s)

## CORRESPONDENCE

All correspondence related to this application should be directed to the approved contact listed below.

☒ Owner ☐ Contractor ☐ Engineer ☐ Architect/Landscape Architect

Amber Culpepper

Lafayette Properties

Name

Company

PO Box 32454

Knoxville

TN

37930

Address

City

State

Zip

865-292-8995

amber@lafayette-investments.com

Phone

Email

## CURRENT PROPERTY INFO

Owner Name (if different from applicant)

Owner Address

Owner Phone

920 TEXAS AVENUE

081-HF-019

Property Address

Parcel ID

ROSEDALE

RN-2

Neighborhood

Zoning

## AUTHORIZATION

Malynda Wollert

Malynda Wollert

5-2-2025

Staff Signature

Please Print

Date

Amber Culpepper

Amber Culpepper

05/01/2025

Applicant Signature

Please Print

Date

REQUEST

DOWNTOWN DESIGN

Level 1:

- ☐ Signs    ☐ Alteration of an existing building/structure

Level 2:

- ☐ Addition to an existing building/structure

Level 3:

- ☐ Construction of new building/structure    ☐ Site design, parking, plazas, landscape

See required Downtown Design attachment for more details.

☐ Brief description of work: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

HISTORIC ZONING

Level 1:

- ☐ Signs    ☐ Routine repair of siding, windows, roof, or other features, in-kind; Installation of gutters, storm windows/doors

Level 2:

- ☐ Major repair, removal, or replacement of architectural elements or materials    ☐ Additions and accessory structures

Level 3:

- ☐ Construction of a new primary building

Level 4:

- ☐ Relocation of a contributing structure    ☐ Demolition of a contributing structure

See required Historic Zoning attachment for more details.

☐ Brief description of work: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

INFILL HOUSING

Level 1:

- ☐ Driveways, parking pads, access point, garages or similar facilities    ☐ Subdivisions

Level 2:

- ☐ Additions visible from the primary street    ☐ Changes to porches visible from the primary street

Level 3:

- ☒ New primary structure  
☒ Site built    ☐ Modular    ☐ Multi-Sectional

See required Infill Housing attachment for more details.

☐ Brief description of work: 1,008 SQ FT, 1 STORY HOME ON CRAWL SPACE . HOME HAS 3 BEDROOMS AND 2 FULL BATHROOMS  
\_\_\_\_\_  
\_\_\_\_\_

STAFF USE ONLY

ATTACHMENTS

- ☐ Downtown Design Checklist  
☐ Historic Zoning Design Checklist  
☐ Infill Housing Design Checklist

ADDITIONAL REQUIREMENTS

- ☐ Property Owners / Option Holders

Level 1: \$50 • Level 2: \$100 • Level 3: \$250 • Level 4: \$500

FEE 1:		TOTAL:  250.00 Paid 5/2/2025 DD
1010	250.00	
FEE 2:		
FEE 3:		

**NEW RESIDENCE**  
**LAFAYETTE INVESTMENTS**  
920 TEXAS AVE., KNOXVILLE, TN 37921

Residence Number	Residence Description	Residence Date
------------------	-----------------------	----------------

SHEET NUMBER	SHEET NAME
G000	COVER SHEET
G001	GENERAL NOTES
G002	GENERAL NOTES
A000	CONCEPT SITE PLAN
A101	FOUNDATION PLAN FLOOR PLAN
A102	ROOF PLAN & TYP. BUILDING SECTION
A200	EXTERIOR ELEVATIONS
A300	FRAMING PLANS

LAFAYETTE  
INVESTMENTS

920 TEXAS AVE., KNOXVILLE, TN 37921

# G000

© COPYRIGHT 2025

\*REFER TO SNOW LOAD & WIND LOAD PER SECTION R301 OF THE INTERNATIONAL RESIDENTIAL CODE (IRC).  
SEISMIC LOADING TO BE BASED ON REQUIREMENTS OF SECTION R301 OF THE IRC.





FASTENING SCHEDULE			
CONNECTION	FASTENER	LOCATION	
JOIST TO SILL OR GIRDER	4-1/8" COMMON	TIDE NAIL PER JOIST	
BRIDGING TO JOIST	2-1/8" COMMON	TIDE NAIL EACH END	
SOLE PLATE TO JOIST OR BLOCKING	3-1/8" @12" O.C.	TYPICAL FACE NAIL	
TOP PLATE TO STUD	2-1/8" COMMON	END NAIL	
STUD TO SOLE PLATE	4-1/8" COMMON	TIDE NAIL	
DOUBLE STUDS	2-1/8" @24" O.C.	FACE NAIL	
DOUBLE TOP PLATES	2-1/8" @ 24" O.C.	TYPICAL FACE NAIL	
DOUBLE TOP PLATES	2-1/8" COMMON	LAP SPLICE	
BLOCKING BETWEEN JOISTS OR RAFTERS TO TOP PLATE	2-1/8" COMMON	TIDE NAIL EACH END	
R-10 JOIST TO TOP PLATE	3-1/8" @12" O.C.	TIDE NAIL	
TOP PLATES, LAPS, & INTERSECTIONS	5-1/8" COMMON	BLOCKING TO SILL OR TOP PLATE (TIDE NAIL) 4-1/8" PER JOIST	
CONT. NUDUS HEADER, TWO PIECES	1/8" COMMON @18" O.C.	ALONG EDGE	
CEILING JOISTS TO PLATE	4-1/8" COMMON	TIDE NAIL	
CONT. NUDUS HEADER TO STUD	4-1/8" COMMON	TIDE NAIL	
CEILING JOISTS, HPS OVER PARTITIONS	4-1/8" COMMON, MINIMUM	FACE NAIL	
CEILING JOISTS, PARALLEL TO RAFTERS	4-1/8" COMMON, MINIMUM	FACE NAIL	
RAFTER TO PLATE, HURRICANE CLPS	2-1/8" COMMON	TIDE NAIL	
BUILT-UP CORNER STUDS	2-1/8" COMMON @24" O.C.	FACE NAIL	
BUILT-UP G-ROD & BEAMS	2/8" COMMON @24" O.C.	FACE NAIL AT TOP & BOTTOM, STAGGERED ON OPPOSITE SIDS	
COLLAR TIE TO Rafter	2-1/8" COMMON	FACE NAIL	
JACK RAFTER TO T & P	3-1/8" COMMON	TIDE NAIL	
	2-1/8" COMMON	FACE NAIL	
RAFTER TO T & P TO RIDGE BEAM	2-1/8" COMMON	TIDE NAIL	
	2-1/8" COMMON	FACE NAIL	
JOIST TO BAND JOIST	4-1/8" COMMON	TIDE NAIL	
LEADER STRIP	3-1/8" COMMON PER FOOT	FACE NAIL	
WOOD STRUCTURAL PANELS & PARTICLE BOARD	1/4" & LESS	1/8" COMMON @12" O.C. EDGE SPC NG 12" O.C. FIELD SPACING	
SUBFLOOR, ROOF, & WALL SHEATHING (TO FRAMING)			
SINGLE FLOOR (COMBINATION SUBFLOOR/UNDERLAYMENT TO FRAMING)			
PANEL 5/8" NO NAIL TO FRAMING	1/4" & LESS	1/8" COMMON @12" O.C. EDGE SPC NG 12" O.C. FIELD SPACING	
FIBERBOARD SHEATHING	1"	1/8" ROOFING @12" O.C. EDGE SPC NG 4" O.C. FIELD SPACING	

ABBREVIATIONS			
A/C	AIR CONDITIONING	FD	FLOOR DRAIN
ABV	ABOVE	FE	FIRE EXTINGUISHER
ACCT	ACCOUSTICAL	FEC	FIRE EXTINGUISHER CABINET
ADJ	ADJUSTABLE	FF	FRESH FLOOR
ADJ	ADJUSTABLE ADJACENT	FI	FLAT HEAD
ADJ	ADJUSTABLE ADJACENT	FHC	FIRE ROSE CABINET
ALUM	ALUMINUM	FH	FIRE HOSE
ARCH	ARCHITECTURAL	FHS	FIRE HOSE
BD	BOARD	FHS	FIRE HOSE
BET	BETWEEN	FHS	FIRE HOSE
BLOC	BLOCKING	FHS	FIRE HOSE
BLOC	BLOCKING	FHS	FIRE HOSE
BW	BENCHMARK BEAM	FHS	FIRE HOSE
BOC	BOTTOM OF CURB	FHS	FIRE HOSE
BOW	BOTTOM OF WALL	FHS	FIRE HOSE
BRC	BEARING	FHS	FIRE HOSE
BTM	BOTTOM	FHS	FIRE HOSE
BUR	BUILT-UP ROOF	FHS	FIRE HOSE
CAB	CABINET	FHS	FIRE HOSE
CA	CATCH BASIN	FHS	FIRE HOSE
CB	CEMENT	FHS	FIRE HOSE
CHNL	CHANNEL	FHS	FIRE HOSE
CL	CONTROL JOINT	FHS	FIRE HOSE
CLG	CEILING	FHS	FIRE HOSE
CLJ	CLEAR(ANCE)	FHS	FIRE HOSE
CMP	CORRUGATED METAL PIPE	FHS	FIRE HOSE
CNU	CONCRETE MASONRY UNIT	FHS	FIRE HOSE
COL	COLLUM	FHS	FIRE HOSE
CONC	CONCRETE	FHS	FIRE HOSE
CONST	CONSTRUCTION	FHS	FIRE HOSE
CONT	CONTINUOUS CONTINUE	FHS	FIRE HOSE
COORD	COORDINATE	FHS	FIRE HOSE
CORR	CORRUGATED CORRIDOR	FHS	FIRE HOSE
CPS	COURSES	FHS	FIRE HOSE
CT	CERAMIC TILE	FHS	FIRE HOSE
CTX	CONTEXTURE	FHS	FIRE HOSE
DA	DOUBLE ACTING	FHS	FIRE HOSE
DF	DRINKING FOUNTAIN	FHS	FIRE HOSE
DIA	DIAMETER	FHS	FIRE HOSE
DIA	DIAMETER	FHS	FIRE HOSE
DM	DEMERSION	FHS	FIRE HOSE
DL	DEAD LOAD	FHS	FIRE HOSE
DN	DOWN	FHS	FIRE HOSE
DR	DOOR	FHS	FIRE HOSE
DS	DOWN SPOUT	FHS	FIRE HOSE
DTL	DETAIL	FHS	FIRE HOSE
DW	DISH WASHER	FHS	FIRE HOSE
DWG	DRAWING	FHS	FIRE HOSE
EF	EACH FACE	FHS	FIRE HOSE
EFS	EXTERIOR INSULATION & FINISH SYSTEM	FHS	FIRE HOSE
EJ	EXPANSION JOINT	FHS	FIRE HOSE
ELEC	ELECTRICAL	FHS	FIRE HOSE
ELEV	ELEVATION, ELEVATOR	FHS	FIRE HOSE
EQ	EQUAL	FHS	FIRE HOSE
EQU	EQUIPMENT	FHS	FIRE HOSE
EQW	EACH WAY	FHS	FIRE HOSE
EWC	ELECTRIC WATER COOLER	FHS	FIRE HOSE
EXH	EXHAUST	FHS	FIRE HOSE
EXT	EXISTING	FHS	FIRE HOSE
EXP	EXPANSION EXPOSED	FHS	FIRE HOSE
EXT	EXTERIOR	FHS	FIRE HOSE

E. ELEVATION NOTES

- EXTERIOR FLASHING TO BE CORRECTLY INSTALLED AT ALL CONNECTIONS BETWEEN ROOF WALLS, CHIMNEYS, PROJECTIONS, AND PENETRATIONS AS REQUIRED BY APPROVED CONSTRUCTION PRACTICES. GENERAL CONTRACTOR TO PROVIDE ASSOCIATE ATIC VENTILATION AND ROOF VENTS PER LOCAL GOVERNING CODE. INSTALL CONTINUOUS RIDGE VENTILATION, AND PRIME & PAINT TO CLOSELY MATCH ROOF COLOR IF APPLICABLE. PROVIDE APPROPRIATE SIGHT VENTILATION AT OVERHANGS.
- ALL PLUMBING AND MECHANICAL VENTS TO BE LOCATED CLOSE TOGETHER WITHIN THE ATIC SPACE WHEN POSSIBLE TO MINIMIZE THE NUMBER OF ROOF PENETRATIONS. ALL PLUMBING AND MECHANICAL VENTS WHICH APPEAR ABOVE THE ROOF TO BE LOCATED AWAY FROM ANY PROMINENT VIEW. NO VENTS TO BE ALLOWED ON THE FRONT ROOF. ALL METAL AND PVC VENTS AND PENETRATIONS TO BE PRIMED & PAINTED TO CLOSELY MATCH THE ROOF COLOR. VERIFY WITH OWNER.
- GENERAL CONTRACTOR TO LOCATE UTILITY METERS AWAY FROM ANY PROMINENT VIEW. UTILITY METERS TO BE LOCATED AS CLOSE TO GRADE AS POSSIBLE TO MINIMIZE THE VISUAL IMPACT OF THE METERS.
- GUTTERS AND DOWNSPOUTS ARE NOT INCLUDED ON THE ELEVATION DRAWINGS. GENERAL CONTRACTOR TO VERIFY THE EXISTING TOPOGRAPHIC GRADIES, AND LOCATE DOWNSPOUTS TOWARDS FRONT AND REAR OF HOUSE BASED ON TOPOGRAPHIC CONDITIONS TO ALLOW POSITIVE DRAINAGE AWAY FROM THE HOUSE. DO NOT LOCATE DOWNSPOUTS IN PROMINENT LOCATIONS. GENERAL CONTRACTOR TO OBTAIN OWNER APPROVAL OF ALL DOWNSPOUT LOCATIONS. GUTTERS AND DOWNSPOUTS TO CLOSELY MATCH TRIM COLOR OF HOUSE, OR IF APPROPRIATE, DOWNSPOUTS MAY BE COLOR-MATCHED TO PRIMARY EXTERIOR MATERIAL.
- PROVIDE WATER-RESISTIVE TRIM AT DORMER ROOFS AND GUTTER GUARDS ON ALL GUTTERS.

M. MASONRY NOTES

- STONE & MASONRY VENEER SHALL BE INSTALLED IN ACCORDANCE WITH IRC SECTION R703.7.
- ANCHORS**  
PROVIDE UNIFORMLY SPACED NAILS COMPLYING WITH ASTM C216, GRADE 5W, TYPE FBS, AND LIME/CEMENT MORTAR CONFORMING TO ASTM C720, TYPE 1.
- INSTALL GALVANIZED ANCHORS #16 @ 6" O.C. EACH WAY WITH CUMULUM PLATED SCREWS.
- MASONRY VENEER ANCHORS TO BE EMBEDDED INTO THE GROUT OF THE VENEER AT LEAST 1 1/2 INCHES AND AT LEAST 1" OF CONCRETE COVERAGE. THE ANCHORS TO BE LOCATED TO THE EXTERIOR AS PER I.R.C. SECTION R703.7.4.
- EXTERIOR WALL COVERINGS & BACKING MATERIALS TO MEET MINIMUM LOADS AS PER I.R.C. SECTION R703.7.4.
- THE VENEER SHALL BE SEPARATED FROM THE SHEATHING BY AN AIR SPACE OF A MINIMUM OF A NOMINAL 1/2 INCH BUT NO MORE THAN 4-1/2".
- FLASHING SHALL BE LOCATED BENEATH THE FIRST COURSE OF MASONRY ABOVE FINISHED GRADE LEVEL ABOVE THE FOUNDATION WALL OR SLAB, AND AT OTHER POINTS OF SUPPORT INCLUDING STRUCTURE FLOORS, SHELF ANGLES & LINTELS, WHEN MASONRY VENEERS ARE DESIGNED IN ACCORDANCE WITH I.R.C. SECTION R703.7.
- WEEPHOLES SHALL BE PROVIDED IN THE OUTSIDE VENTHES OF MASONRY WALLS AT A MAXIMUM SPACING OF 33" O.C.
- WEEPHOLES SHALL NOT BE LESS THAN 3/16" IN DIAMETER. WEEPHOLES SHALL BE LOCATED IMMEDIATELY ABOVE THE FLASHING, AS PER I.R.C. SECTION R703.7.4.
- EXTERIOR PLASTER**  
EXTERIOR PLASTER SHALL BE INSTALLED IN ACCORDANCE WITH IRC SECTION R703.6.
- PLASTER PROTECT ALL LATH & LATH ATTACHMENTS SHALL BE OF CORROSION-RESISTANT MATERIAL. EXPANDED METAL WOVEN CORROSION-RESISTANT MATERIAL, EXPANDED METAL WOVEN HAVING A 7/16" HEAD, OR 7/8" LONG, 1/4" GAUGE STAPLES SPACED AT NO MORE THAN 6" OR AS OTHERWISE PROVIDED.
- PLASTER FINISHING WITH FORD AND COATING PLASTER SHALL BE NOT LESS THAN (3) COATS WHEN APPLIED OVER METAL LATH OR WIRE, AND SHALL BE NOT LESS THAN (2) COATS WHEN APPLIED OVER MASONRY. CONCRETE, PRESERVE PRESERVATIVE TREATED WOOD, OR DECAY RESISTANT WOOD AS SPECIFIED IN IRC SECTION R317.1, OR OYPHUS BACKING IF THE PLASTER SURFACE IS COMPLETELY COVERED BY VENEER OR OTHER FINISHING MATERIAL. PLASTER SHALL BE NOT LESS THAN 5/8" THICKNESS AS SET FORTH IN TABLE R702.1(1).
- WATER RESISTIVE BARRIERS**  
A. A MINIMUM 60.019 INCH (26ga GALVANIZED SHEET) WEEP SCREEN, WITH A MINIMUM VERTICAL ATTACHMENT FLANGE OF 3/4" SHALL BE PROVIDED AT OR BELOW THE FOUNDATION PLATE LINE ON EXTERIOR STUD WALLS IN ACCORDANCE WITH ASTM C-926.  
B. THE WEEP SCREEN SHALL BE PLACED A MINIMUM OF 4" ABOVE THE EARTH OR 2" ABOVE PAVED AREAS AND SHALL BE OF A TYPE THAT WILL ALLOW TRAPPED WATER TO DRAIN TO THE EXTERIOR OF THE BUILDING.  
C. THE WEATHER-RESISTANT BARRIER SHALL LAP THE WEEP SCREENED ATTACHMENT FLANGE.  
D. THE EXTERIOR LATH SHALL COVER & TERMINATE ON THE ATTACHMENT FLANGE OF THE WEEP SCREEN.
- WATER RESISTIVE BARRIERS**  
A. WATER-RESISTIVE BARRIERS SHALL BE INSTALLED IN ACCORDANCE WITH SECTION R703.2 AND, WHERE APPLIED OVER WOOD-BASED SHEATHING, SHALL INCLUDE A WATER-RESISTIVE VAPOR-PERMEABLE BARRIER.  
B. A WATER-RESISTIVE VAPOR-PERMEABLE BARRIER APPLIED BETWEEN WOOD-BASED SHEATHING AND STUCCO SHALL NOT BE A DRAINAGE TYPE.
- WATER RESISTIVE BARRIERS**  
A. WATER-RESISTIVE BARRIERS SHALL BE INSTALLED IN ACCORDANCE WITH SECTION R703.2 AND, WHERE APPLIED OVER WOOD-BASED SHEATHING, SHALL INCLUDE A WATER-RESISTIVE VAPOR-PERMEABLE BARRIER.  
B. A WATER-RESISTIVE VAPOR-PERMEABLE BARRIER APPLIED BETWEEN WOOD-BASED SHEATHING AND STUCCO SHALL NOT BE A DRAINAGE TYPE.

EL. ELECTRICAL NOTES

- ELECTRICAL PLANS ILLUSTRATE BASIC DESIGN INTENT ONLY. ELECTRICAL CONTRACTOR TO BE RESPONSIBLE FOR ADHERING TO ALL APPLICABLE CODES AND SAFETY REQUIREMENTS. VERIFY FIXTURE SELECTION AND LOCATION WITH OWNER.
- LIGHT FIXTURES TO BE INSTALLED AS CLOSELY AS POSSIBLE TO THE LOCATION SHOWN ON THE ELECTRICAL PLANS. LIGHT FIXTURES TO ALIGN WITH OTHER LIGHT FIXTURES OR WITH ADJACENT HVAC SAYS AND RACS.
- GENERAL CONTRACTOR AND ELECTRICAL CONTRACTOR TO REVEAL THE PLANE AND WALK THROUGH THE JOB TO VERIFY THAT THE DESIGN INTENT IS MAINTAINED. GENERAL CONTRACTOR TO NOTIFY THE ARCHITECT IF ANY ITEMS ARE DIFFERENT FROM THE ELECTRICAL PLANS. BEFORE THE INSTALLATION OF FIXTURES, SWITCHES, ETC.
- GAS OR ELECTRICAL SERVICE TO BE PROVIDED AS REQUIRED FOR ALL APPLIANCES AND EQUIPMENT SUCH AS REFRIGERATOR, FREEZER, DISHWASHER, DISPOSAL, COOKTOP, OVENS, WASHER, DRYER, HVAC EQUIPMENT, ALARMS, PANELS, ETC. PROVIDE OUTLET ABOVE RANGE FOR MICROWAVE OR HOOD VENT IF FINA KITCHEN LAYOUT PERMITS.
- ALL OUTLETS LOCATED NEAR ANY WATER CONDITION TO BE G.F.I. TYPE.
- SWITCHES AND OUTLETS TO BE COORDINATED WITH THE OWNER AND COLOR-MATCHED WITH INTERIOR TRIM.
- PROVIDE WATERPROOF OUTLETS AS PER PLANS.
- GENERAL CONTRACTOR TO VERIFY WITH THE OWNER ALL LOCATIONS OF PHONE OUTLETS, COMPUTER OUTLETS, AND ELECTRONIC DEVICE OUTLETS. ALL COMPUTER OUTLETS TO BE ON A DEDICATED CIRCUIT.
- GENERAL CONTRACTOR TO VERIFY WITH THE OWNER THE LOCATIONS OF CABLE TV OUTLETS.
- DIMMERS TO BE USED FOR THE APPROPRIATE LOAD OF THE FIXTURES AND LAMPS. SELECTED, SLIDE-TYPE DIMMERS ARE PREFERRED.
- VERIFY TRIM SIZE FOR ALL DOORS AND WINDOWS. VERIFY TRIM SIZE FOR ALL DOORS AND WINDOWS TO TRIM AND ALIGN WITH EACH OTHER IF THERE ARE MULTIPLE SWITCHES.
- BLOCK AND PREWIRE SEPARATE SWITCHES TO EACH LIGHT AND CELLULASE WOOD.
- GENERAL CONTRACTOR TO VERIFY WITH THE ARCHITECT AND/OR LANDSCAPE ARCHITECT ALL EXTERIOR LIGHTING CIRCUITS AND SWITCHES.
- GENERAL CONTRACTOR TO VERIFY WITH THE OWNER WHETHER EXTERIOR SECURITY LIGHTS ARE DESIRED. IF SO, GENERAL CONTRACTOR TO VERIFY THE TYPE OF FIXTURE, LOCATION, AND REQUIRED SWITCHING.
- GENERAL CONTRACTOR TO COORDINATE ALL THE REQUIREMENTS OF AN ALARM SYSTEM, IF ONE IS DESIRED.
- PROVIDE HANDWHELD SMOKE DETECTORS WITH BATTERY BACKUP ON ALL FLOORS AND IN EACH BEDROOM, VERIFIED WITH LOCAL CODE REQUIREMENTS. PROVIDE FOR HVAC UNITS. NUMBER OF UNITS TO BE DETERMINED BY THE LOCAL MECHANICAL CONTRACTOR.
- HVAC UNITS ARE NOT TO BE WIRED/LOCATED NEXT TO MASTER BEDROOM OR PATIO/DECK AREAS.
- LOCAL VENTILATION:  
A. PROVIDE 50 CFM VENTILATION FAN (MINIMUM) FOR EACH BATHROOM & LAVATORY.  
B. PROVIDE 100 CFM VENTILATION FAN AT KITCHEN RANGE HOOD.
- EXISTING PANEL BOX MAY REQUIRE RELOCATION OF RIGHT (B) PAGES.
- DECORATIVE LIGHT FIXTURES TO BE SELECTED BY THE OWNER AND COORDINATED WITH THE GENERAL CONTRACTOR. THE OWNER TO APPROVE ALL SUBSTITUTIONS.
- GENERAL CONTRACTOR TO COORDINATE THE LAMP SELECTION (PRECESSED CAN SIZE AND TRIM) WITH THE OWNER.
- ELECTRIC AND GAS METERS TO BE LOCATED AWAY FROM ANY PROMINENT VIEW. (VERIFY WITH LOCAL UTILITY).


W. WOOD DECK NOTES

- ALL CONSTRUCTION SHALL BE PER INTERNATIONAL RESIDENTIAL BUILDING CODE.
- DECK LOADS ARE 40 LB LIVE LOAD AND 15 LB DEAD LOAD. ANY SPECIAL LOADS SHOULD BE CONSIDERED AS WELL.
- THE GENERAL CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND SITE CONDITIONS BEFORE STARTING WORK. THE ARCHITECT/ENGINEER SHALL BE NOTIFIED OF ANY DISCREPANCY.
- CONTRACTOR SHALL USE SIMPSON "STRONG-TIE" (OR APPROVED EQUIVALENT) WOOD FRAMING ANCHORS HANGERS, HOLD-DOWNS, ETC. FOR ALL WOOD-TO-WOOD CONNECTIONS. ALL ANCHORS TO BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.
- FOR ALL HANDRAILS AND FASTENERS (JOIST HANGERS, POST ANCHORS, MECHANICAL FASTENERS, NAILS, SCREWS, BOLTS, ETC.) SHALL BE GALVANIZED WITH 1.85 GUM OF ZINC (G-185 COATING) OR STAINLESS STEEL. ALL HANDRAILS AND FASTENERS (JOIST HANGERS, POST ANCHORS, MECHANICAL FASTENERS, NAILS, SCREWS, BOLTS, ETC.) SHALL BE STAINLESS STEEL. LOOK FOR PRODUCTS SUCH AS "2X4X" FROM SIMPSON STRONG-TIE OR "TRIPLE ZINC" FROM USP.
- UNLESS NOTED OTHERWISE IN THESE DETAILS, ALL FRAMING LUMBER SHALL BE SOUTHERN PINE, GRADE #2 OR BETTER, AND SHALL BE PRESSURE TREATED ACCORD TO CA-B IN ACCORDANCE WITH AMERICAN WOOD PRESERVERS ASSOCIATION STANDARDS. ALL LUMBER IN CONTACT WITH THE GROUND SHALL BE RATED AS "GROUND CONTACT". PLEASE NOTE THAT NOT ALL TREATED LUMBER IS RATED FOR GROUND CONTACT.
- ALL DECKING MATERIAL SHALL BE 2x6 OR 2x4 (FIVE QUARTER BOARD, ATTACH DECKING TO EACH JOIST WITH A MINIMUM OF (2) BRGS SHANK, 8D NAILS OR 2 1/2" WOOD SCREWS. DECKING MAY BE APPLIED DIAGONALLY AT A 45 DEGREE ANGLE PERPENDICULAR TO THE JOISTS. DECKING COMPOSED OF FOREIGN LUMBER, COMPOSITE OR MANUFACTURED MATERIALS MAY BE SUBSTITUTED ONLY WHEN THE PRODUCT HAS AN APPROVED EVALUATION REPORT FROM AN ACCREDITED TESTING LABORATORY. CHECK WITH YOUR LOCAL BUILDING DEPARTMENT FOR APPROVED MATERIALS OR REFER TO THE LIST OF APPROVED DECKING PRODUCTS.
- FOR STAIRS & GUARDRAILS: SEE "STAIRS & RAILINGS" WITH FRAMING NOTES.

ENERGY CODE

- ATTIC CEECE HATCHES & DOORS MUST BE WEATHER STRIPPED & INSULATED TO THE SAME LEVEL AS THE SURROUNDING SURFACES.
- FLOOR INSULATION MUST BE INSTALLED TO MAINTAIN PERMANENT CONTACT WITH THE UNDERSIDE OF THE SUBFLOOR DECKING.
- PROGRAMMABLE THERMOSTATS WITH DAILY SETBACK CAPABILITY REQUIRED WHERE PRIMARY HEATING SYSTEM IS PROGRAMED AIR WITH A SETTING NOT HIGHER THAN 70° FAHREHIT FOR HEATING, AND NOT LOWER THAN 70° FAHREHIT FOR COOLING.
- SUPPLY DUCTS IN ATTIC RETAIN R-8 INSULATION REQUIREMENT REQUIREMENTS FOR ALL OTHER DUCTS IN UNCONDITIONED SPACE REDUCED TO R-6.
- THE ENTIRE DUCT SYSTEM MUST BE SEALED.

ICC PRESCRIPTIVE REQUIREMENTS	ZONE 4
WINDOWS (SFACTOR)	0.55
SUNLIGHTS (SFACTOR)	0.50
CEILING - OPEN ATIC	41
CEILING - CANNED (R-VALUE)	30
ROOF RAFTER WALL (R-VALUE)	20 / (5-6)
CEILING - CANNED (R-VALUE)	30
WALLS - R-VALUE	13 / (1-2)
BASEMENT WALL (R-VALUE)	10 / (1-2)
SLAB (R-VALUE & DOPH)	10, 2 FTL
GRAVEL SPACE WALL (R-VALUE)	10 / (1-2)

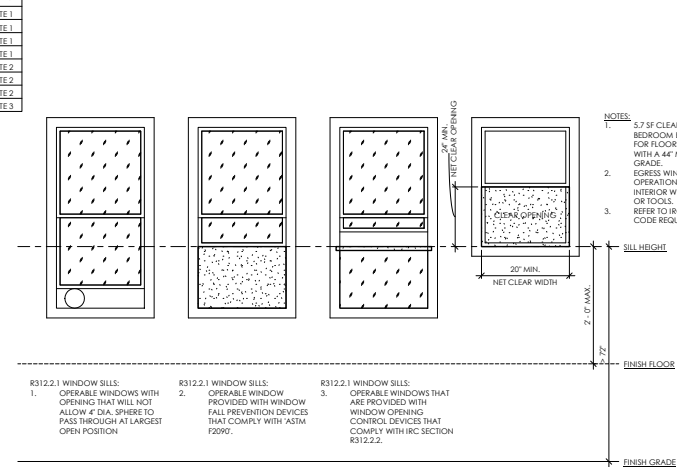

1 Egress Window Requirements

1" = 1'-0"



NOTE: This item has been digitally signed and sealed. Digital signatures must be verified on electronic files. Reproduced copies of digitally signed, dated, and sealed documents are not considered signed and sealed.

Revision Number	Revision Description	Revision Date
-----------------	----------------------	---------------

NEW RESIDENCE

# A101

2025.02  
MSG


1. CONTRACTOR SHALL ADHERE TO ALL CODES, RULES AND REGULATIONS GOVERNING CONSTRUCTION AND THE USE OF MATERIALS AS SET BY THE CITY OF CHICAGO, ALL CODES AND BUILDING DEPARTMENT AGENCIES.
2. DRAWINGS ARE TO BE CONSIDERED AS NOT MAILED.
3. ALL DIMENSIONS ON MASONRY ARE FROM THE FINISHED FACE OF THE MASONRY UNLESS OTHERWISE NOTED.
4. ALL DIMENSIONS ON EXTERIOR FRAMING ARE FROM EXTERIOR FACE OF STUD TO EXTERIOR FACE OF STUD, UNLESS NOTED OTHERWISE.
5. INTERIOR DIMENSIONS ORIGINATE FROM THE INTERIOR FACE OF THE EXTERIOR WALL UNLESS OTHERWISE NOTED.
6. INTERIOR PARTITIONS ARE DIMENSIONED FROM THE CENTER OF WALL TO CENTER OF WALL, UNLESS NOTED OTHERWISE.
7. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND LOCATIONS IN THE FIELD AND CORRECT ANY OF ANY DISCREPANCIES PRIOR TO THE START OF WORK.
8. THE CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE LOCAL ORDINANCES FOR UTILITY SERVICES.
9. THE CONTRACTOR SHALL BE RESPONSIBLE FOR LOCATING ALL EXISTING UNDERGROUND UTILITIES, WHERE ENCOUNTERED; MAKE ALL NECESSARY ARRANGEMENTS FOR SUPPORT, SHORE-UP AND PROTECT ALL UTILITIES DISCOVERED.
10. THE CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE LOCAL OR PRIVATE UTILITY COMPANIES.
11. THE CONTRACTOR SHALL EXERCISE EXTREME CAUTION WHEN WORKING AROUND EXISTING UTILITIES AND UNDERGROUND LINES.
12. AT ALL TIMES THE CONTRACTOR SHALL BE SOLELY AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOBSITE AND THE SAFETY OF ALL PERSONS AND PROPERTY.
13. ALL LUMBER IN CONTACT WITH CONCRETE OR MASONRY LESS THAN 18" FROM THE GROUND SHALL BE PRESSURE TREATED OR REDWOOD.

THESE DRAWINGS ARE FOR GENERAL CONSTRUCTION OF THE BUILDING ENVELOPE AND PARTITIONING OF INTERIOR SPACES. SITE ELECTRICAL MECHANICAL AND PLUMBING PLANS ARE NOT INCLUDED IN THIS DRAWINGS SET AND ARE THE RESPONSIBILITY OF THE APPROPRIATE DISCIPLINES IN COORDINATION WITH THE OWNER.

LOCATIONS OF PLUMBING FIXTURES ARE APPROXIMATES. SPECIFIC LOCATION SHOULD COMPLY WITH CURRENT BUILDING CODES AND REGULATIONS AND ARE THE RESPONSIBILITY OF THE CONTRACTOR.


[illegible]



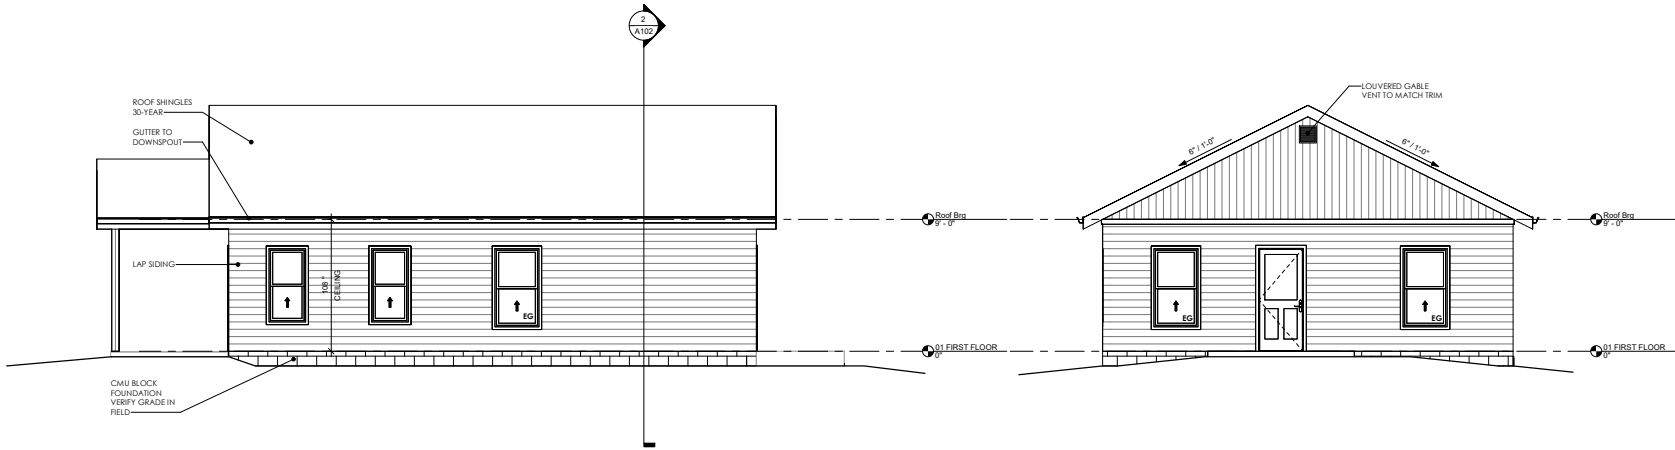


4 EAST ELEVATION  
1/4" = 1'-0"

3 REAR ELEVATION  
1/4" = 1'-0"

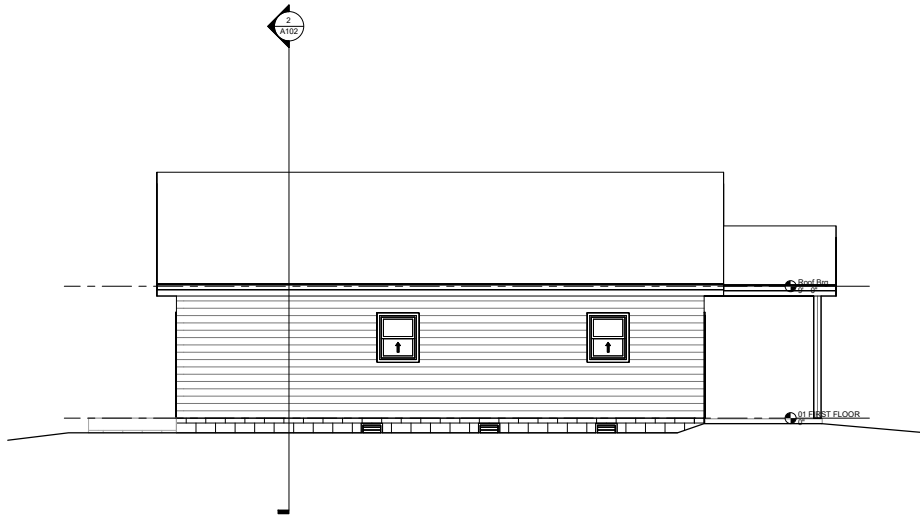

2 WEST ELEVATION  
1/4" = 1'-0"

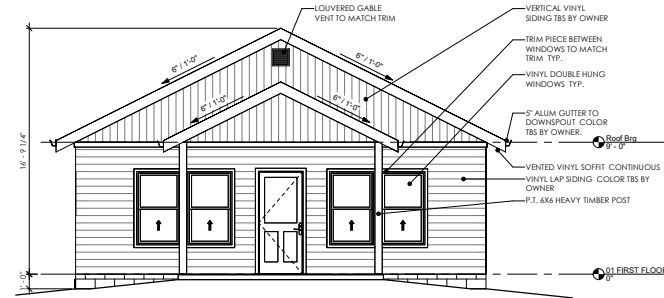

1 FRONT ELEVATION  
1/4" = 1'-0"


LAFAYETTE  
INVESTMENTS

NEW RESIDENCE


920 TEXAS AVE., KNOXVILLE, TN 37921

FRAMING PLANS

A300

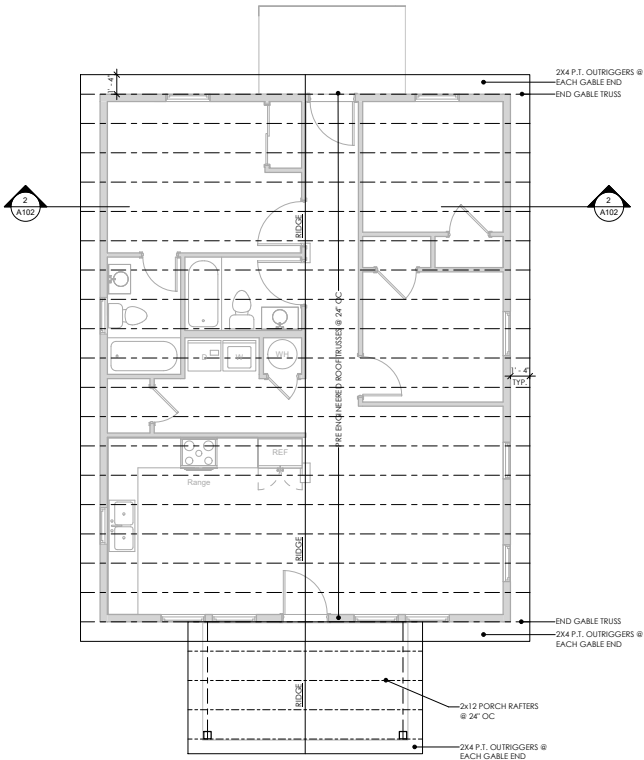

② FRAMING PLAN - ROOF  
1/4" = 1'-0"

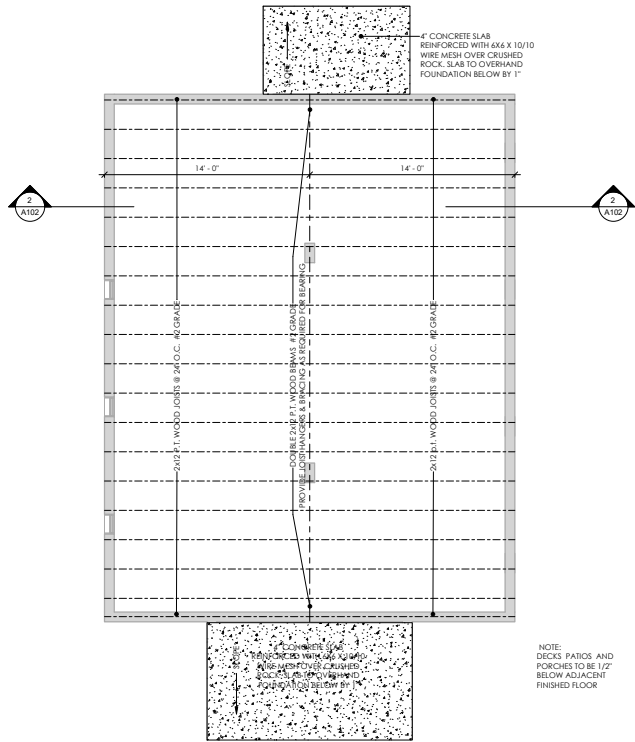

① FRAMING PLAN - FIRST FLOOR  
1/8" = 1'-0"

NOTE: DECKS, PATIOS AND PORCHES TO BE 1/2" BELOW ADJACENT FINISHED FLOOR